



ROSATOM

Rosatom State Atomic Energy Corporation

Course: Fundamentals of AES-2006 technology

Module 05: VVER (AES-2006) Safety Systems

Date	June, 2017
Prepared by:	Denis Podoliakin
Reviewed by:	Fedor Karmanov
Final methodological control by:	Natalia Shulepova, Maria Melnikova
Translation quality checked by:	Natalia Shulepova, Maria Melnikova
Based on materials prepared by:	Rosatom Technical Academy (RosatomTech)



RUSATOMSERVICE



- Terminal Training Objectives:

1. To list the safety systems used to carry out functions for DBC and DEC-A conditions
2. To list the AES-2006/E safety systems used in Hanhikivi-1 NPP

- Enabling Training Objectives:

1. To familiarize trainees with the basic requirements and nuclear safety approaches implementation in the AES-2006/E
2. To describe the defence-in-depth concept implementation for AES-2006/E
3. To list the VVER safety systems
4. To describe the principles of safety system operation of the NPP with VVER

1. Safety fundamentals for NPPs
2. Design and Safety Functions
3. VVER Safety Systems
 - A. Reactivity control
 - B. Heat removal from nuclear fuel
 - C. Localization of activity



ROSATOM

Rosatom State Atomic Energy Corporation

Safety Fundamentals for NPPs



RUSATOMSERVICE



*I. **Safety*** is the state of being "safe" (from French sauf), the condition of being protected from harm or other non-desirable outcomes. Safety can also refer to the control of recognized hazards in order to achieve an acceptable level of risk. [Wikipedia]

*II. “**Safety**”* means the protection of people and the environment against radiation risks, and the safety of facilities and activities that give rise to radiation risks. “*Safety*” as used here and in the IAEA safety standards includes the safety of nuclear installations, radiation safety, the safety of radioactive waste management and safety in the transport of radioactive material; it does not include non-radiation-related aspects of safety. [IAEA]

III. [Nuclear] safety

The achievement of proper operating conditions, prevention of accidents or mitigation of accident consequences, resulting in protection of workers, the public and the environment from undue radiation hazards. [IAEA]

IV. Safety – the condition of being protected from or unlikely to cause danger, risk, or injury. [Oxford dictionary]

V. Safety is a property of nuclear power plants to provide reliable protection of personnel, the public and the environment from the unacceptable radiation exposure in accordance with federal norms and rules in the use of atomic energy. [www.rosatom.ru]

VI. Safety – the use of nuclear energy must be safe; it shall not cause injury to people, or damage to the environment or property. [Finland, Nuclear Energy Act 11.12.1987/990. Section 6 – Safety]




Bhopal, 1984

An accident at the pesticide plant in Bhopal, India, released at least 30 tons of a highly toxic gas. The plant was surrounded by shanty towns, leading to more than 600,000 people being exposed to the deadly gas cloud that night

Deaths: At least 3,787; over 16,000 claimed

Non-fatal injuries: At least 558,125

Top 20 accidents with the highest total cost

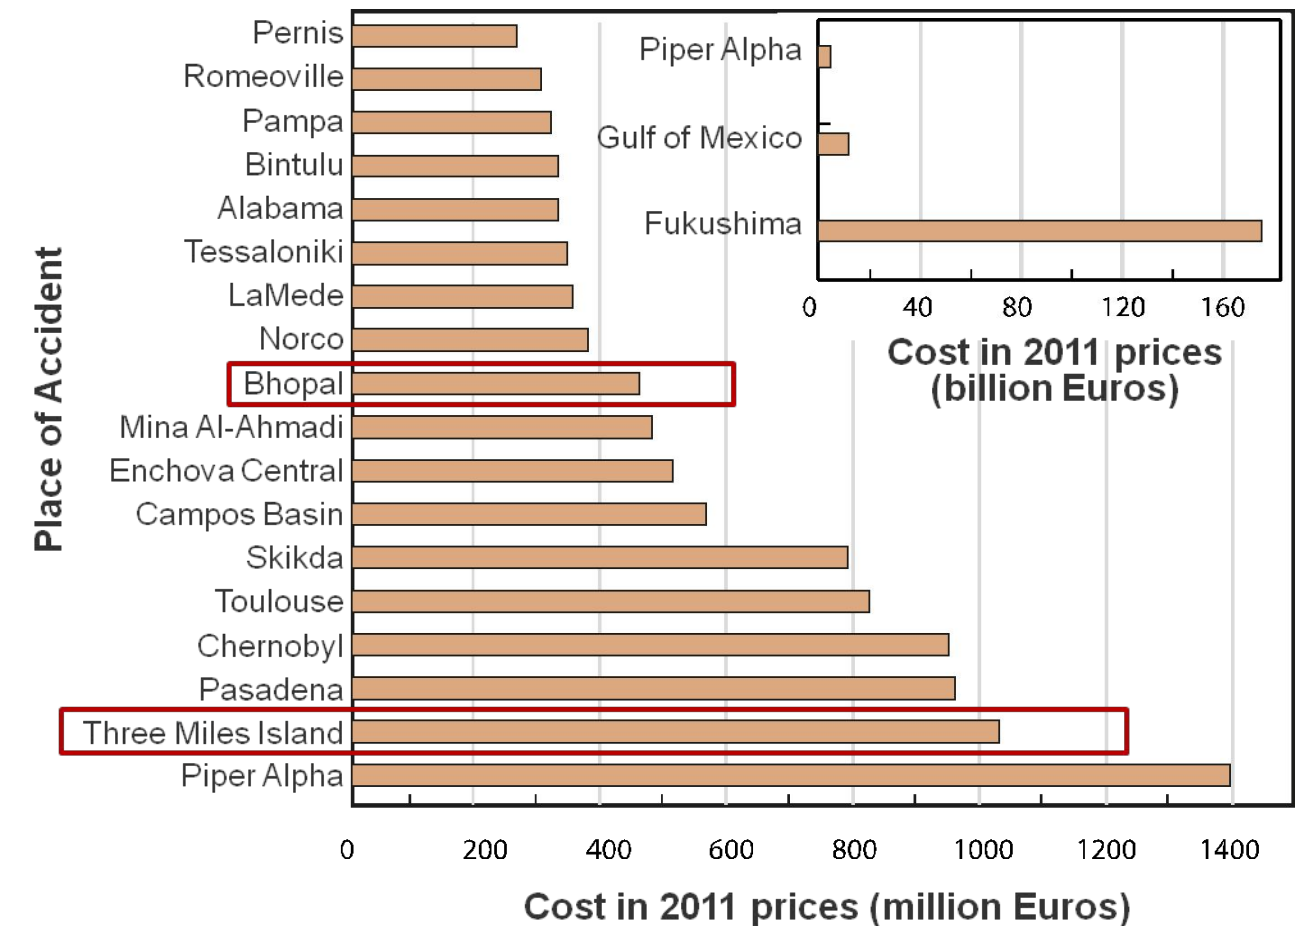

www.ariquemesonline.com.br/noticia.asp?cod=302779&codDep=24

Pasadena, 1989

Devastating series of explosions and fire in Pasadena, US. The initial blast registered 3.5 on the Richter scale, and the conflagration took 10 hours to bring under control. Twenty-three employees were killed and 314 injured

- The organisation operating a nuclear power plant shall be responsible for the plant's safe operation under all operational states and accident conditions
- Personnel shall be encouraged to perform responsible work, and to identify, report, and eliminate factors endangering safety. Personnel shall be given the opportunity to contribute to the continuous improvement of safety
- SAHARA principle – safety as high as reasonably achievable



ROSATOM


Rosatom State Atomic Energy Corporation


Design and Safety Functions



RUSATOMSERVICE



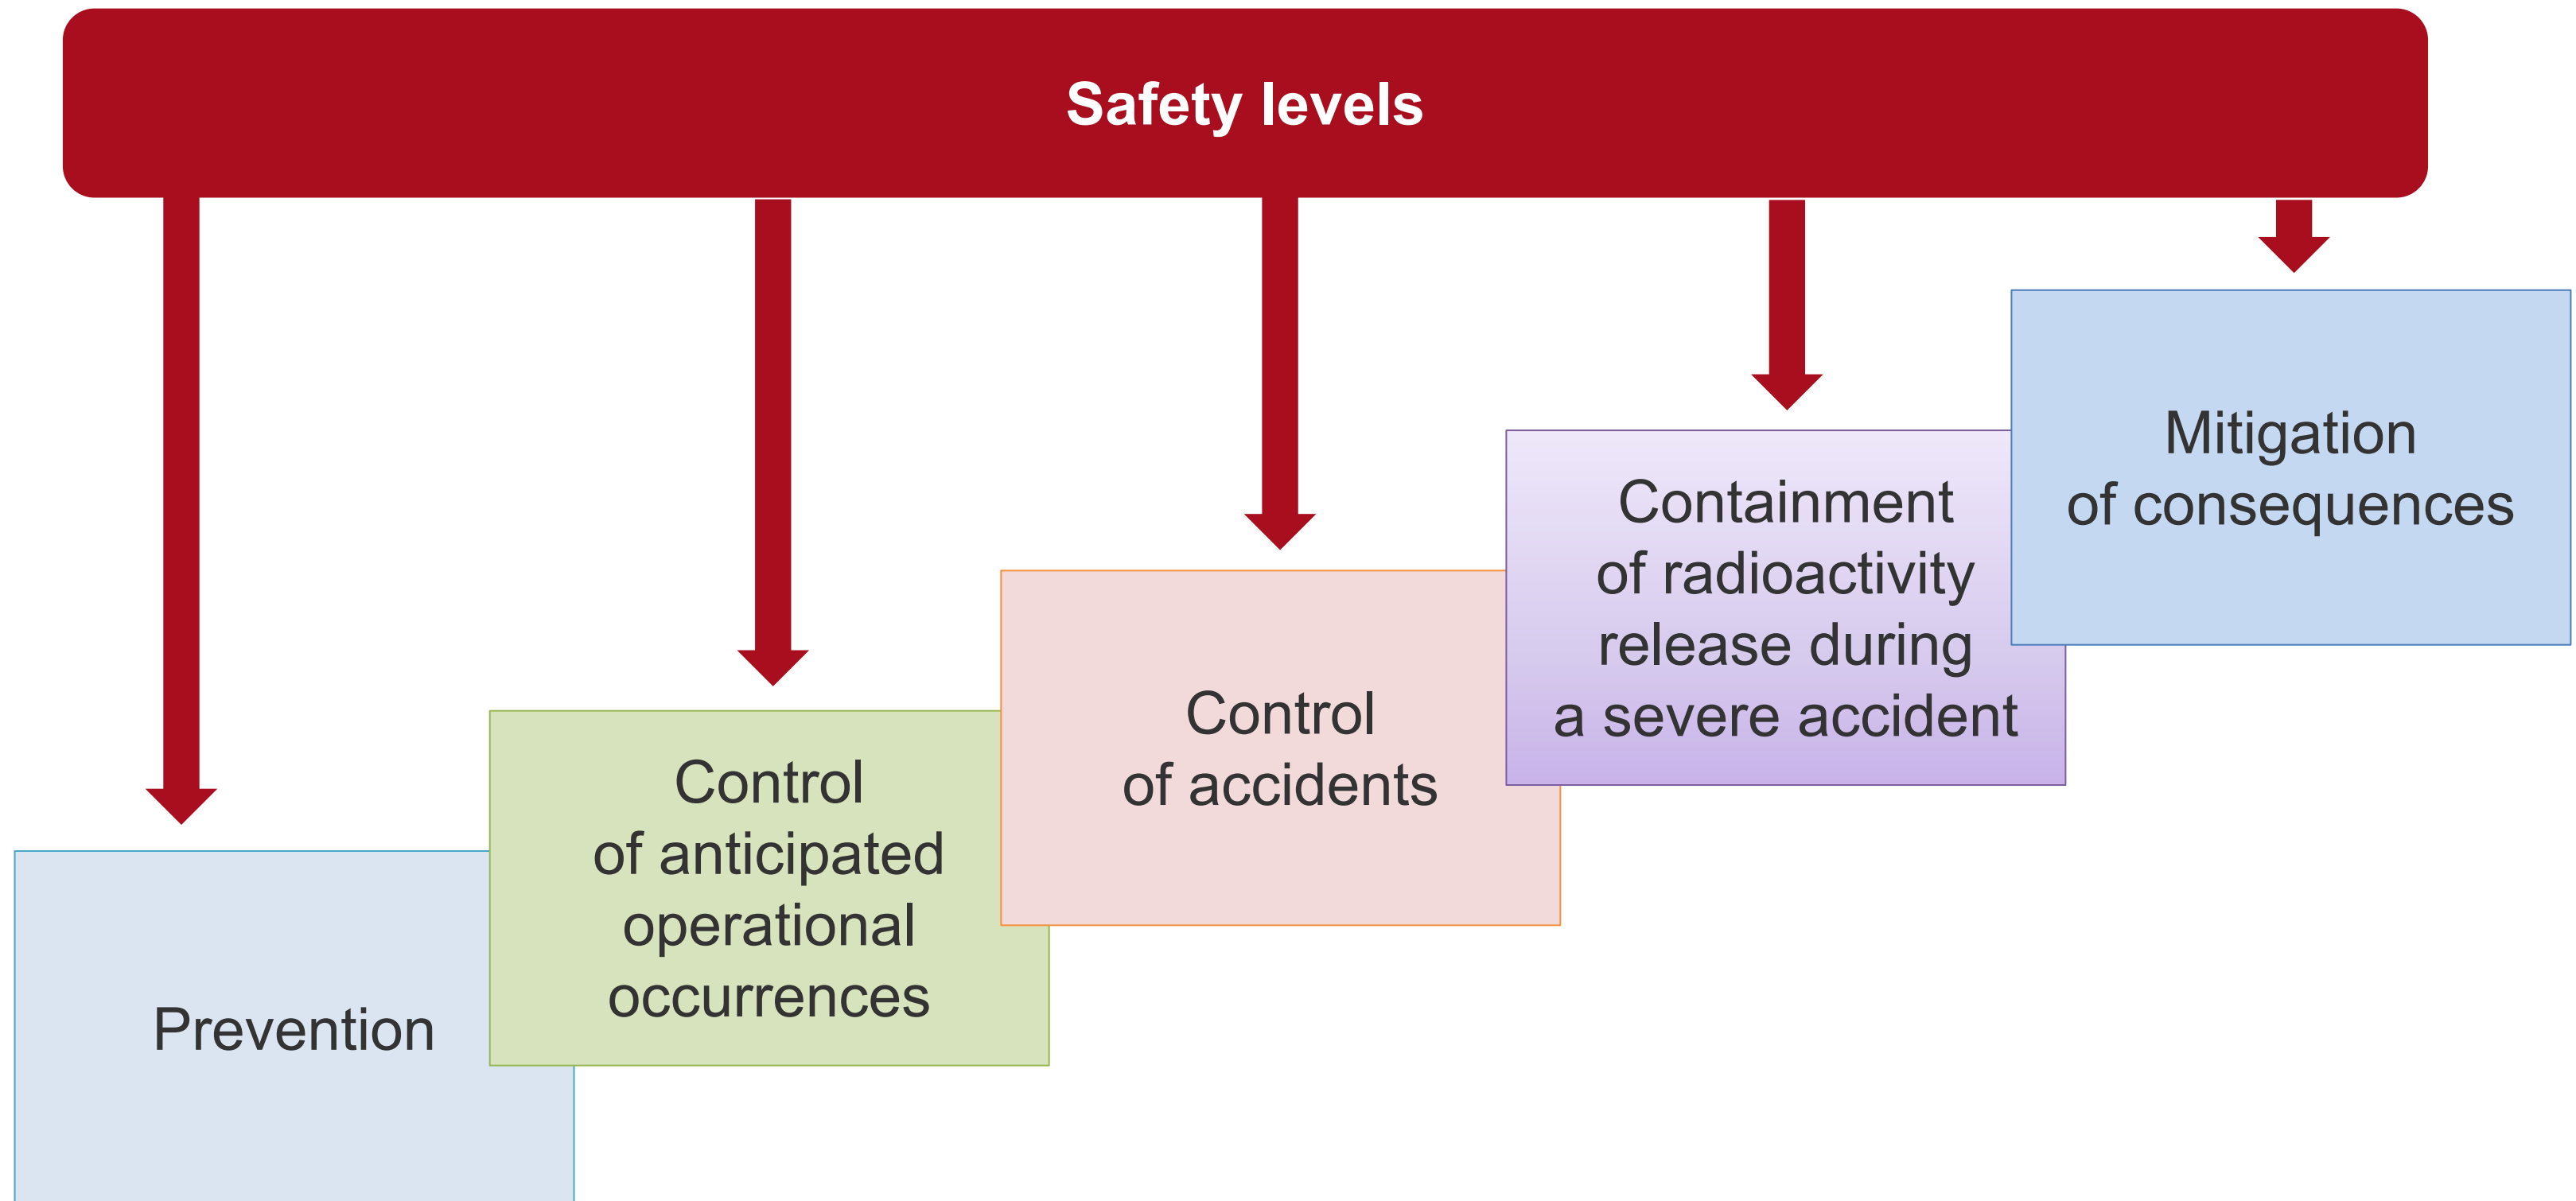

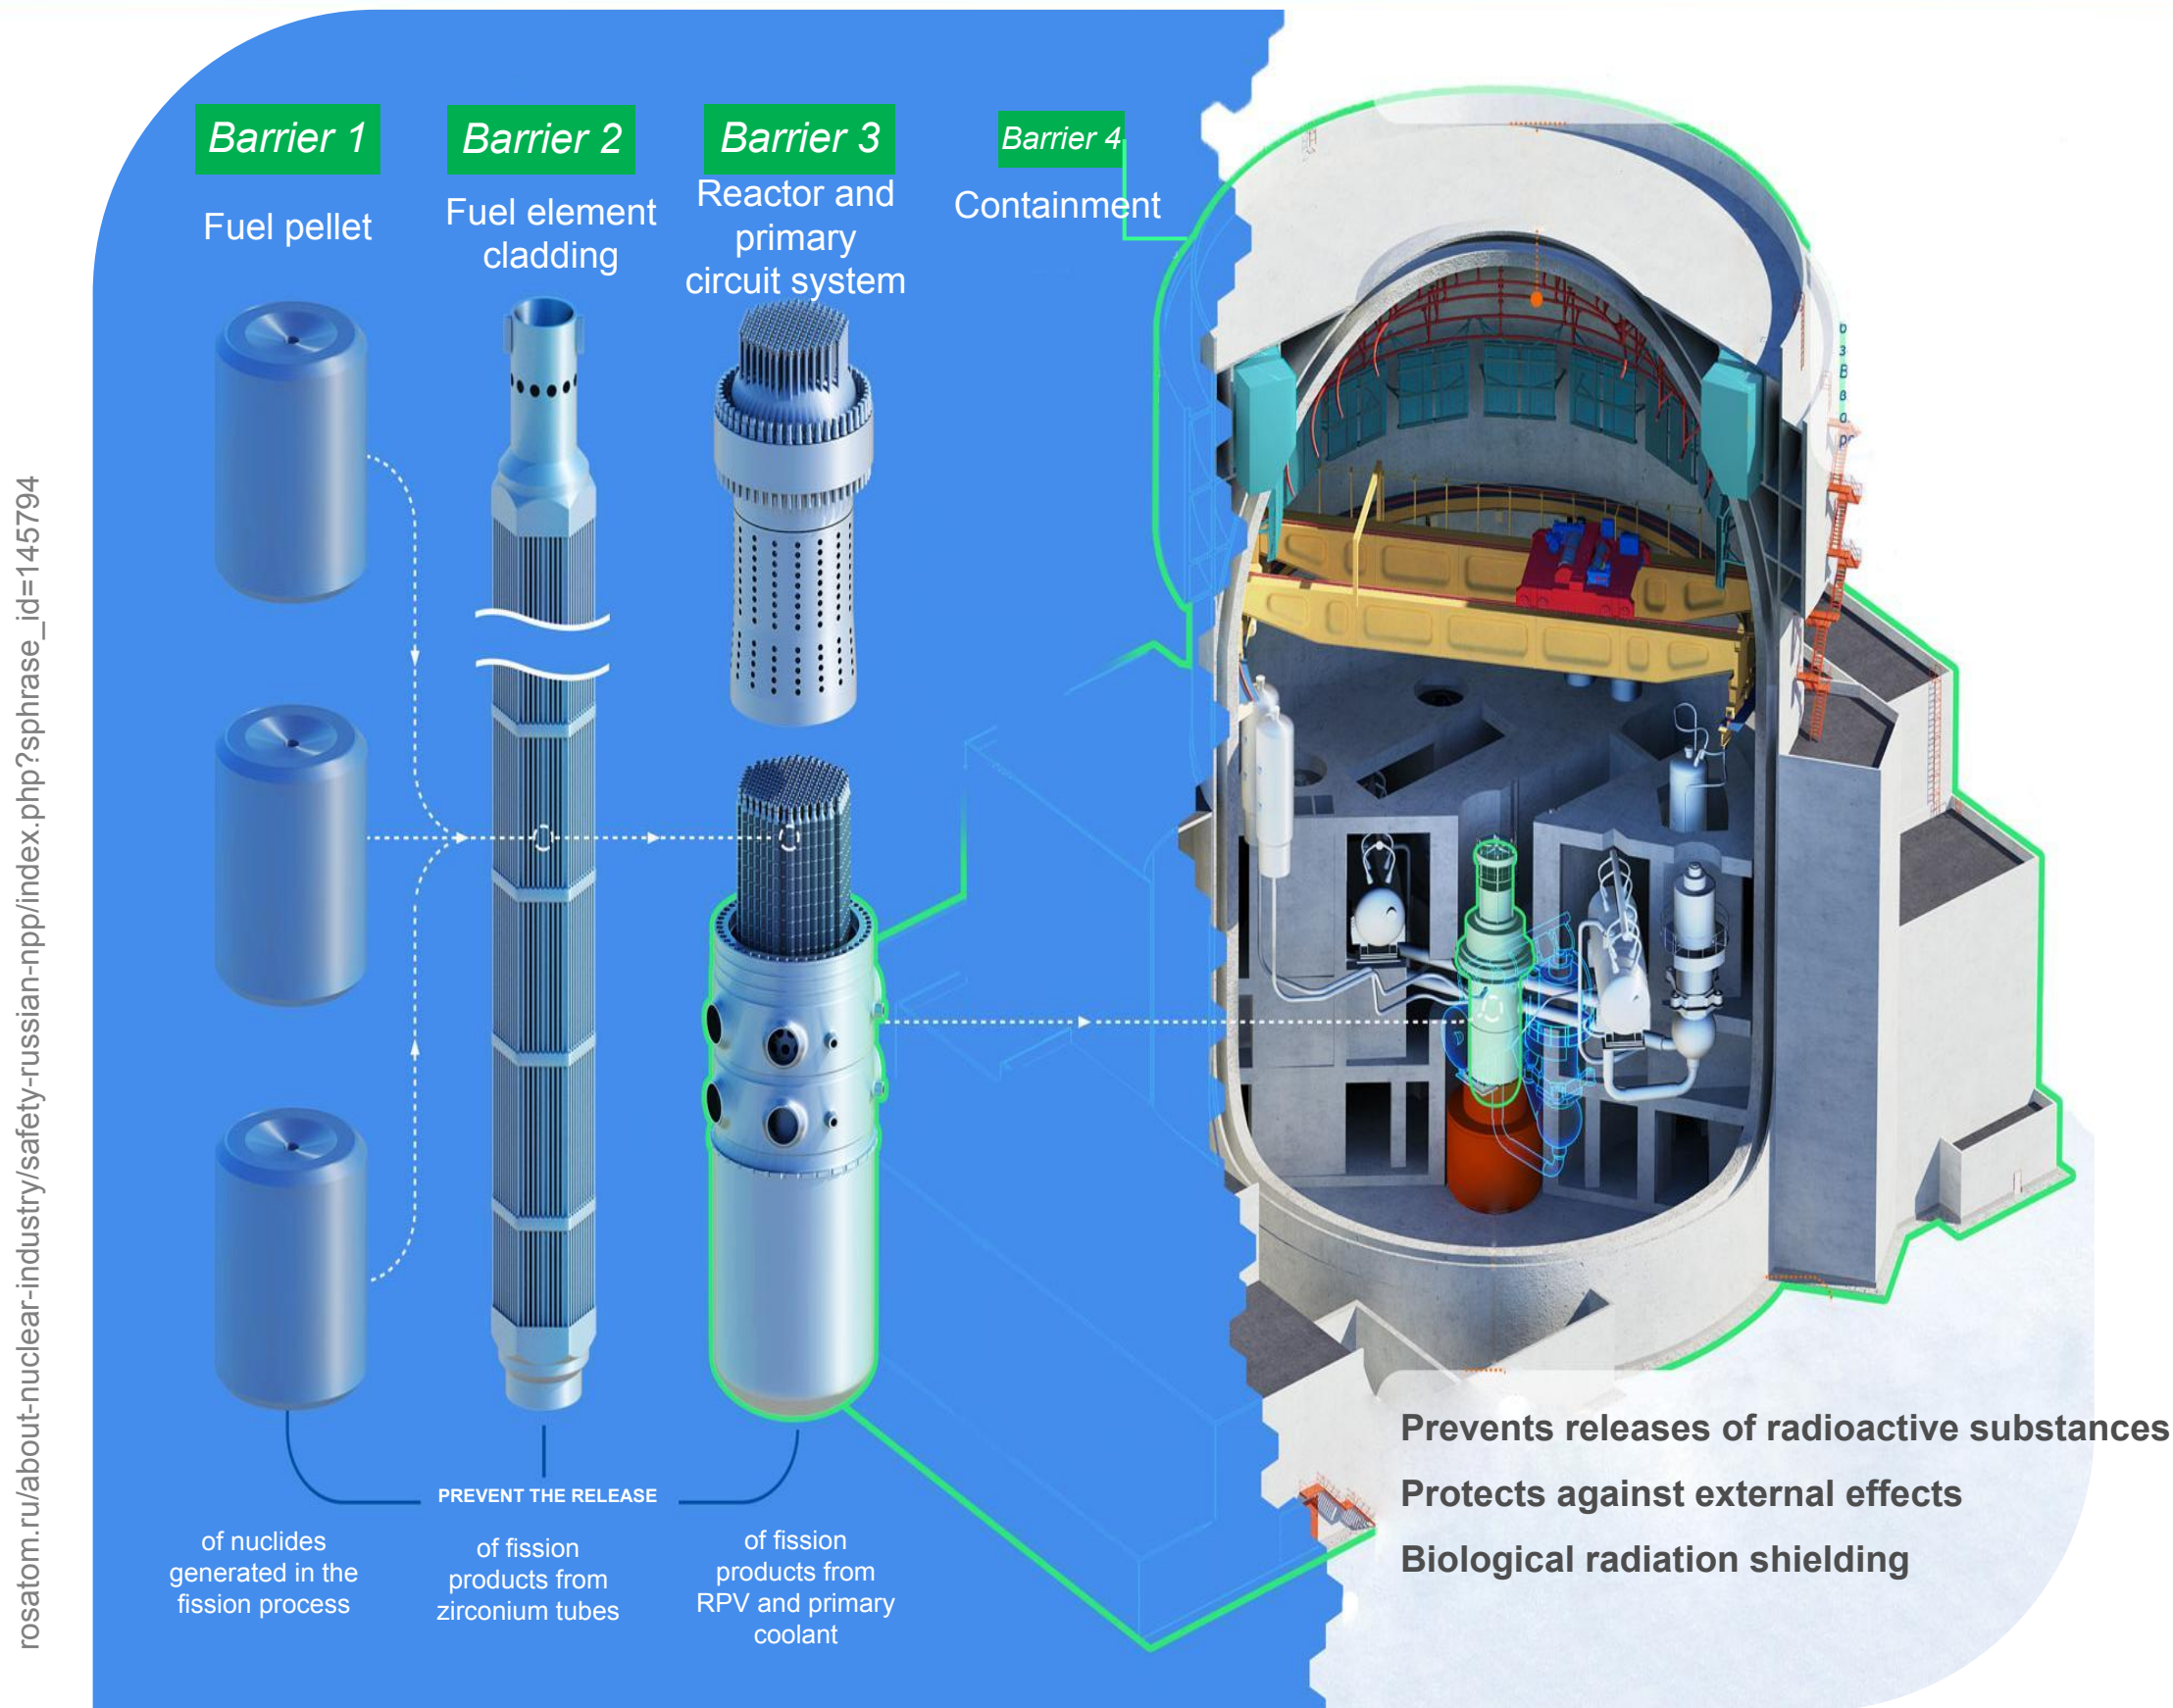

Defense-in-depth is a philosophy
to ensure nuclear safety

Organizational and technical measures

- Level 1. Prevention of abnormal operation and failures
- Level 2. Control of abnormal operation and detection of failures
- Level 3. Control of accidents


New safety requirements


- Level 4. Severe accident management
- Level 5. Emergency planning

Physical barriers

- Fuel matrix (pallets)
- Fuel rod cladding
- Reactor coolant system boundary
- Containment

Population and environment protection



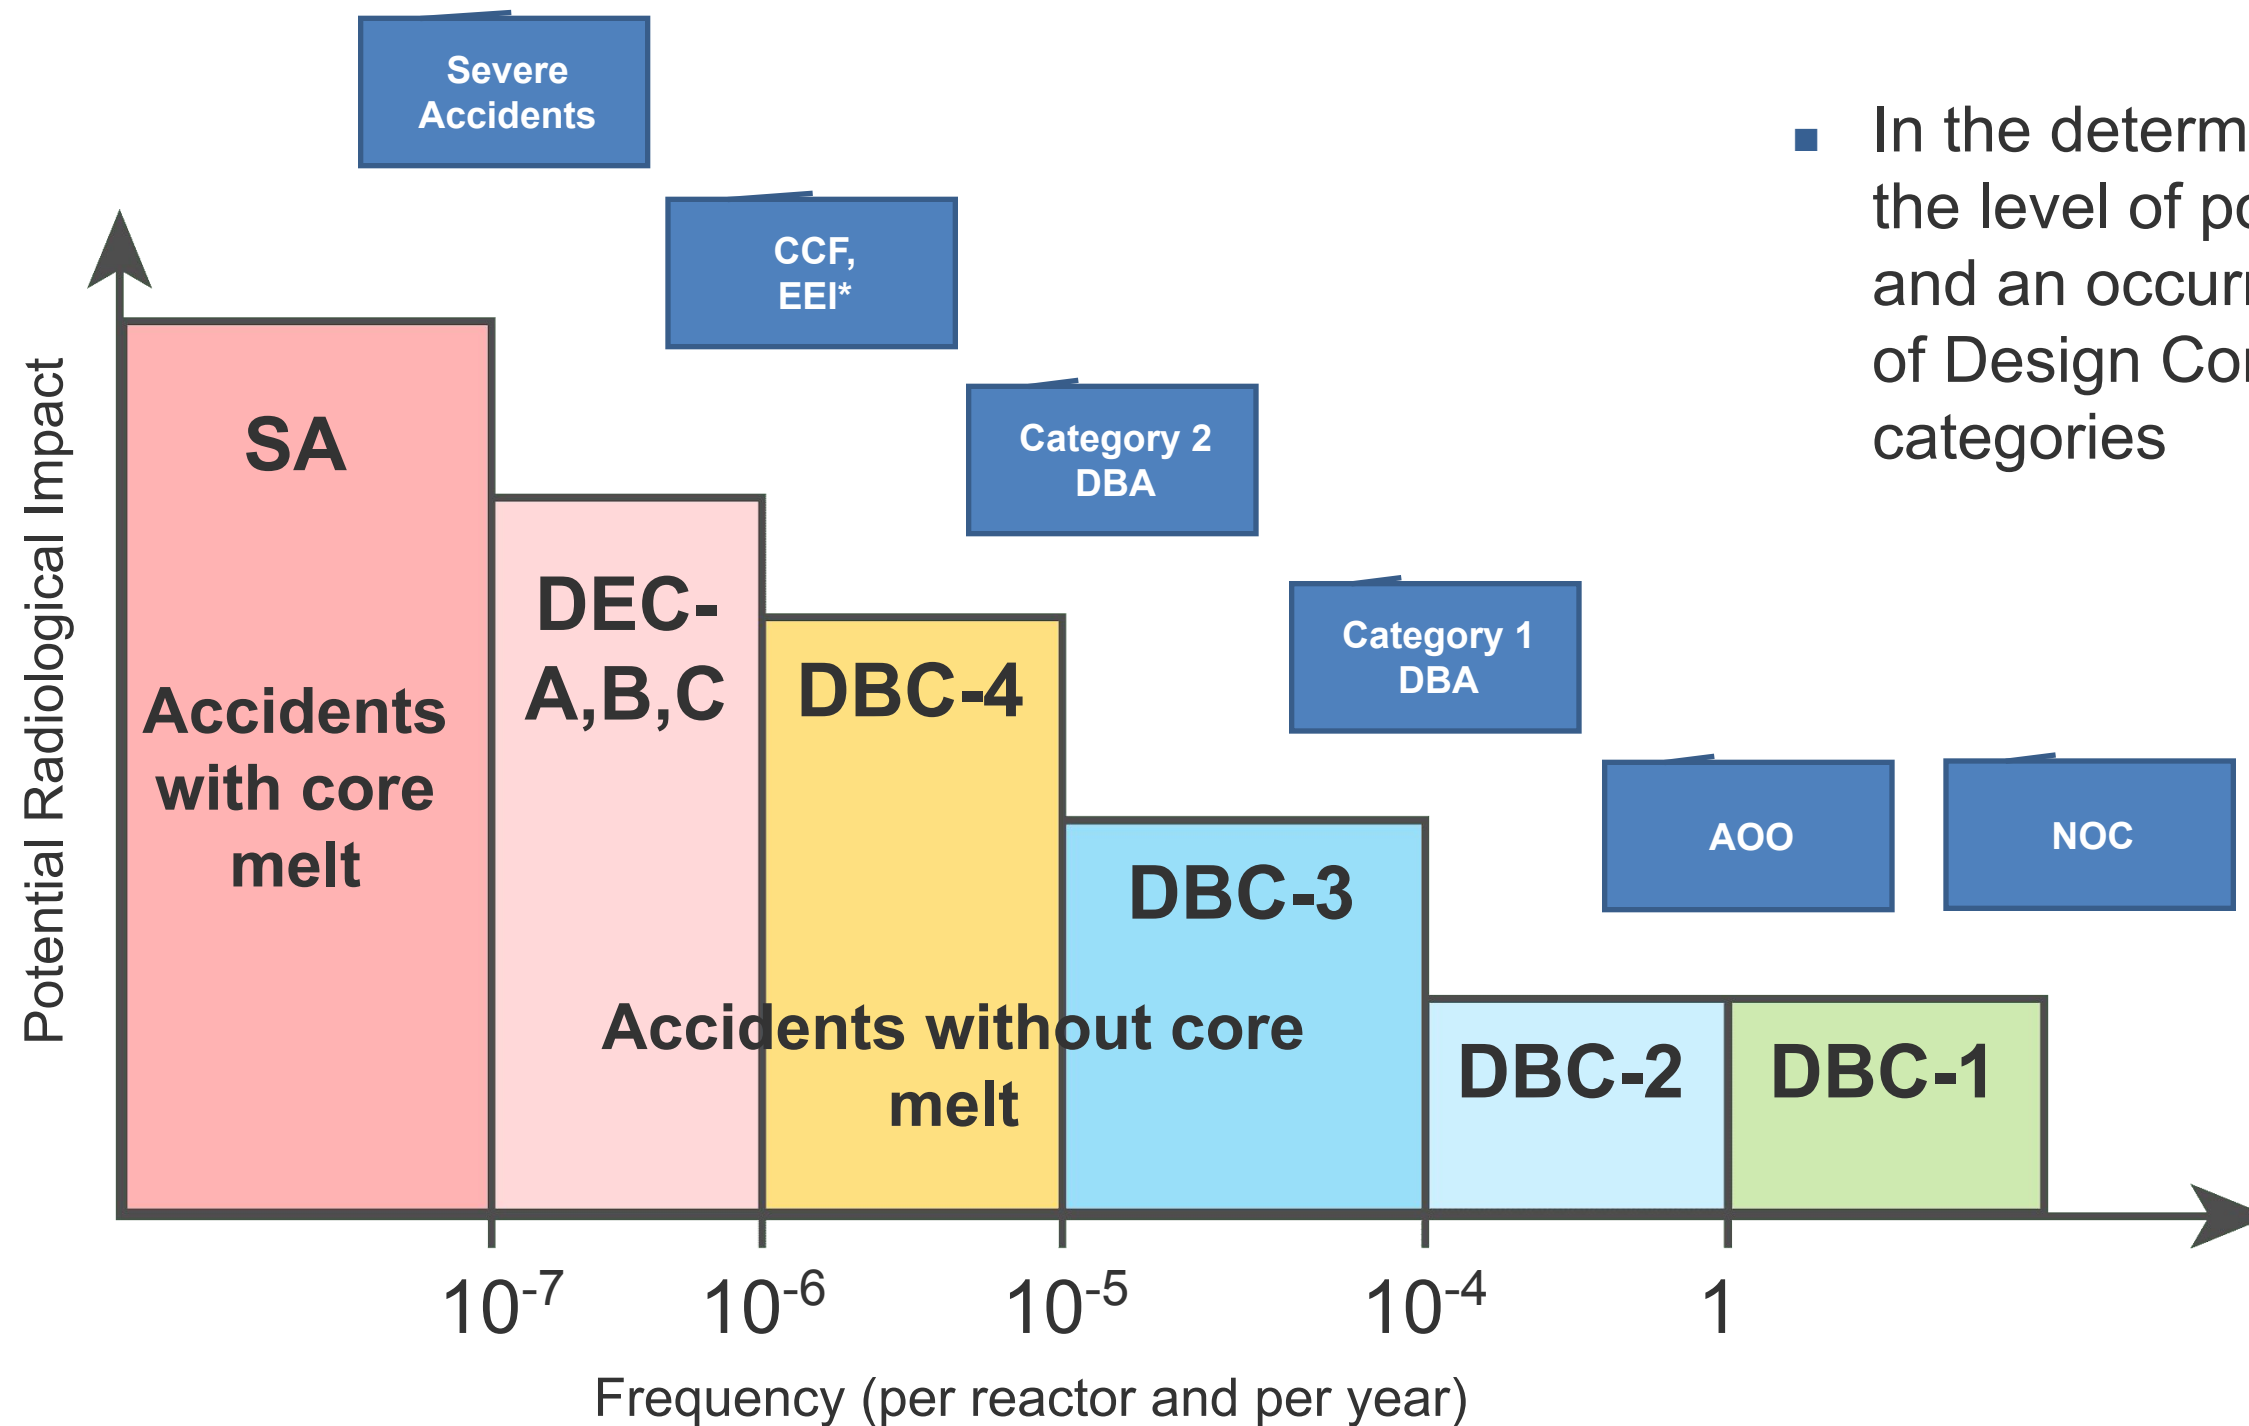

- In the deterministic safety analysis, as per the level of possible negative consequences and an occurrence probability, the list of Design Conditions is divided into several categories


*) DBA – Design Basis Accident
 CCF – Common Cause Failure events
 EEI – Extremely External Impacts

- Acceptance criteria for each category of design conditions
- Safety analysis to justify the acceptance criteria

- Activity release into containment atmosphere under LOCA accidents is ever determined by presence of damaged fuel cladding in the core. The following acceptance criteria are justified in the design:
 - For DBC-3 – the number of damaged fuel rods shall not exceed 1% of the total number of fuel rods in the core
 - For DBC-4 –the number of damaged fuel rods shall not exceed 10% of the total number of fuel rods in the core



- In accordance with Gov. Decree 717/2013 (and then YVL C.3) in case of accidents the expected annual irradiation dose of the critical group of population shall be limited with:
 - DBC-3 – effective dose below 1 mSv
 - DBC-4 – effective dose below 5 mSv
 - DEC – effective dose below 20 mSv
- Severe accidents:
 - Not more than 100 TBq for atmospheric releases of Cs-137. *No large scale protective measures for the population nor any long-term restrictions on the use of extensive areas of land and water are required. Evacuation of people living in close proximity to the NPP is not required*

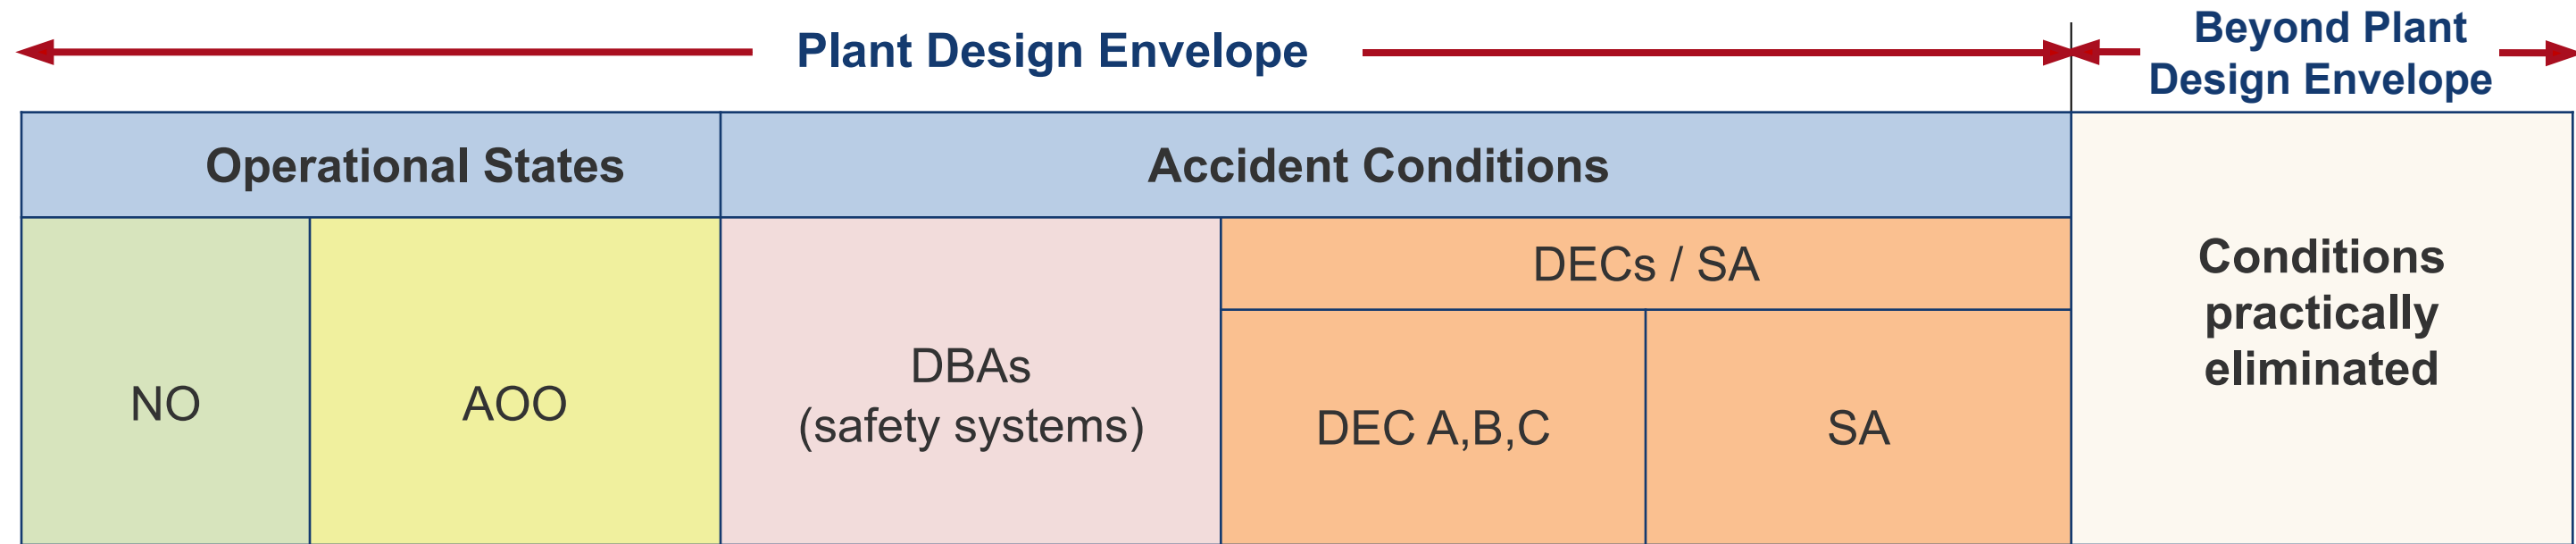

LEVELS OF DEFENCE IN DEPTH



Conditions

Operational plant states

During and after any design basis accident

In emergency conditions arising in the case of beyond design basis accidents

Functions

Control of reactivity

Removal of heat from the reactor

Confinement of radioactive material, shielding against radiation and control of planned radioactive releases, as well as limitation of accidental radioactive releases



ROSATOM

Rosatom State Atomic Energy Corporation

VVER Safety Systems



RUSATOMSERVICE



Level 3 is divided into levels 3a and 3b:

Level 3a includes systems ensuring execution of safety functions during accidents of classes 1 and 2 (DBC-3 and DBC-4)

Level 3b includes systems ensuring execution of safety functions under the conditions when level 3a systems cannot perform their functions as a result of common-cause failures, external effects or other complex accident sequences

Accident management strategy includes:

- bringing the NPP to the controlled state
- bringing the NPP to the safe state

Controlled state is the state when the fission chain reaction stops and residual heat is removed from the fuel

Safe state is the state when the fission chain reaction stops, residual heat is removed from the fuel and there is no excessive pressure within physical barriers 3 and 4


Basic safety functions	A. Reactivity control	B. Heat removal from nuclear fuel	C. Localization of activity
	AA: Fission reaction termination	BA: Maintenance of primary coolant inventory	CA: Limitation of pressure inside the containment, heat removal from the containment
	AB: Reactor power limitation	BB: Heat removal from primary coolant	CB: Localization inside the containment
	AC: Subcriticality assurance	BC: Primary circuit integrity assurance	CC: Localization outside the containment
		BD: Secondary circuit integrity assurance	CD: Localization in SG
		BE: Cooling of spent fuel	CE: Localization in auxiliary systems
			CF: Fuel handling
			CG: Radioactive waste handling

Safety systems are designed in accordance with the principles ensuring their reliability and failure tolerance:

- Redundancy principle
 - system redundancy – application of multi-train systems
 - component redundancy – component and equipment redundancy within system trains
- Independence principle
 - physical separation
 - functional separation
- Diversity principle
 - application of means based on different principles of operation
 - different physical variables
 - different operating conditions
 - different equipment manufacturers

Reliability of safety systems and equipment is provided by the quality of their design, manufacturing and maintenance. It is expressed by their safety class

General diagram of safety systems and means

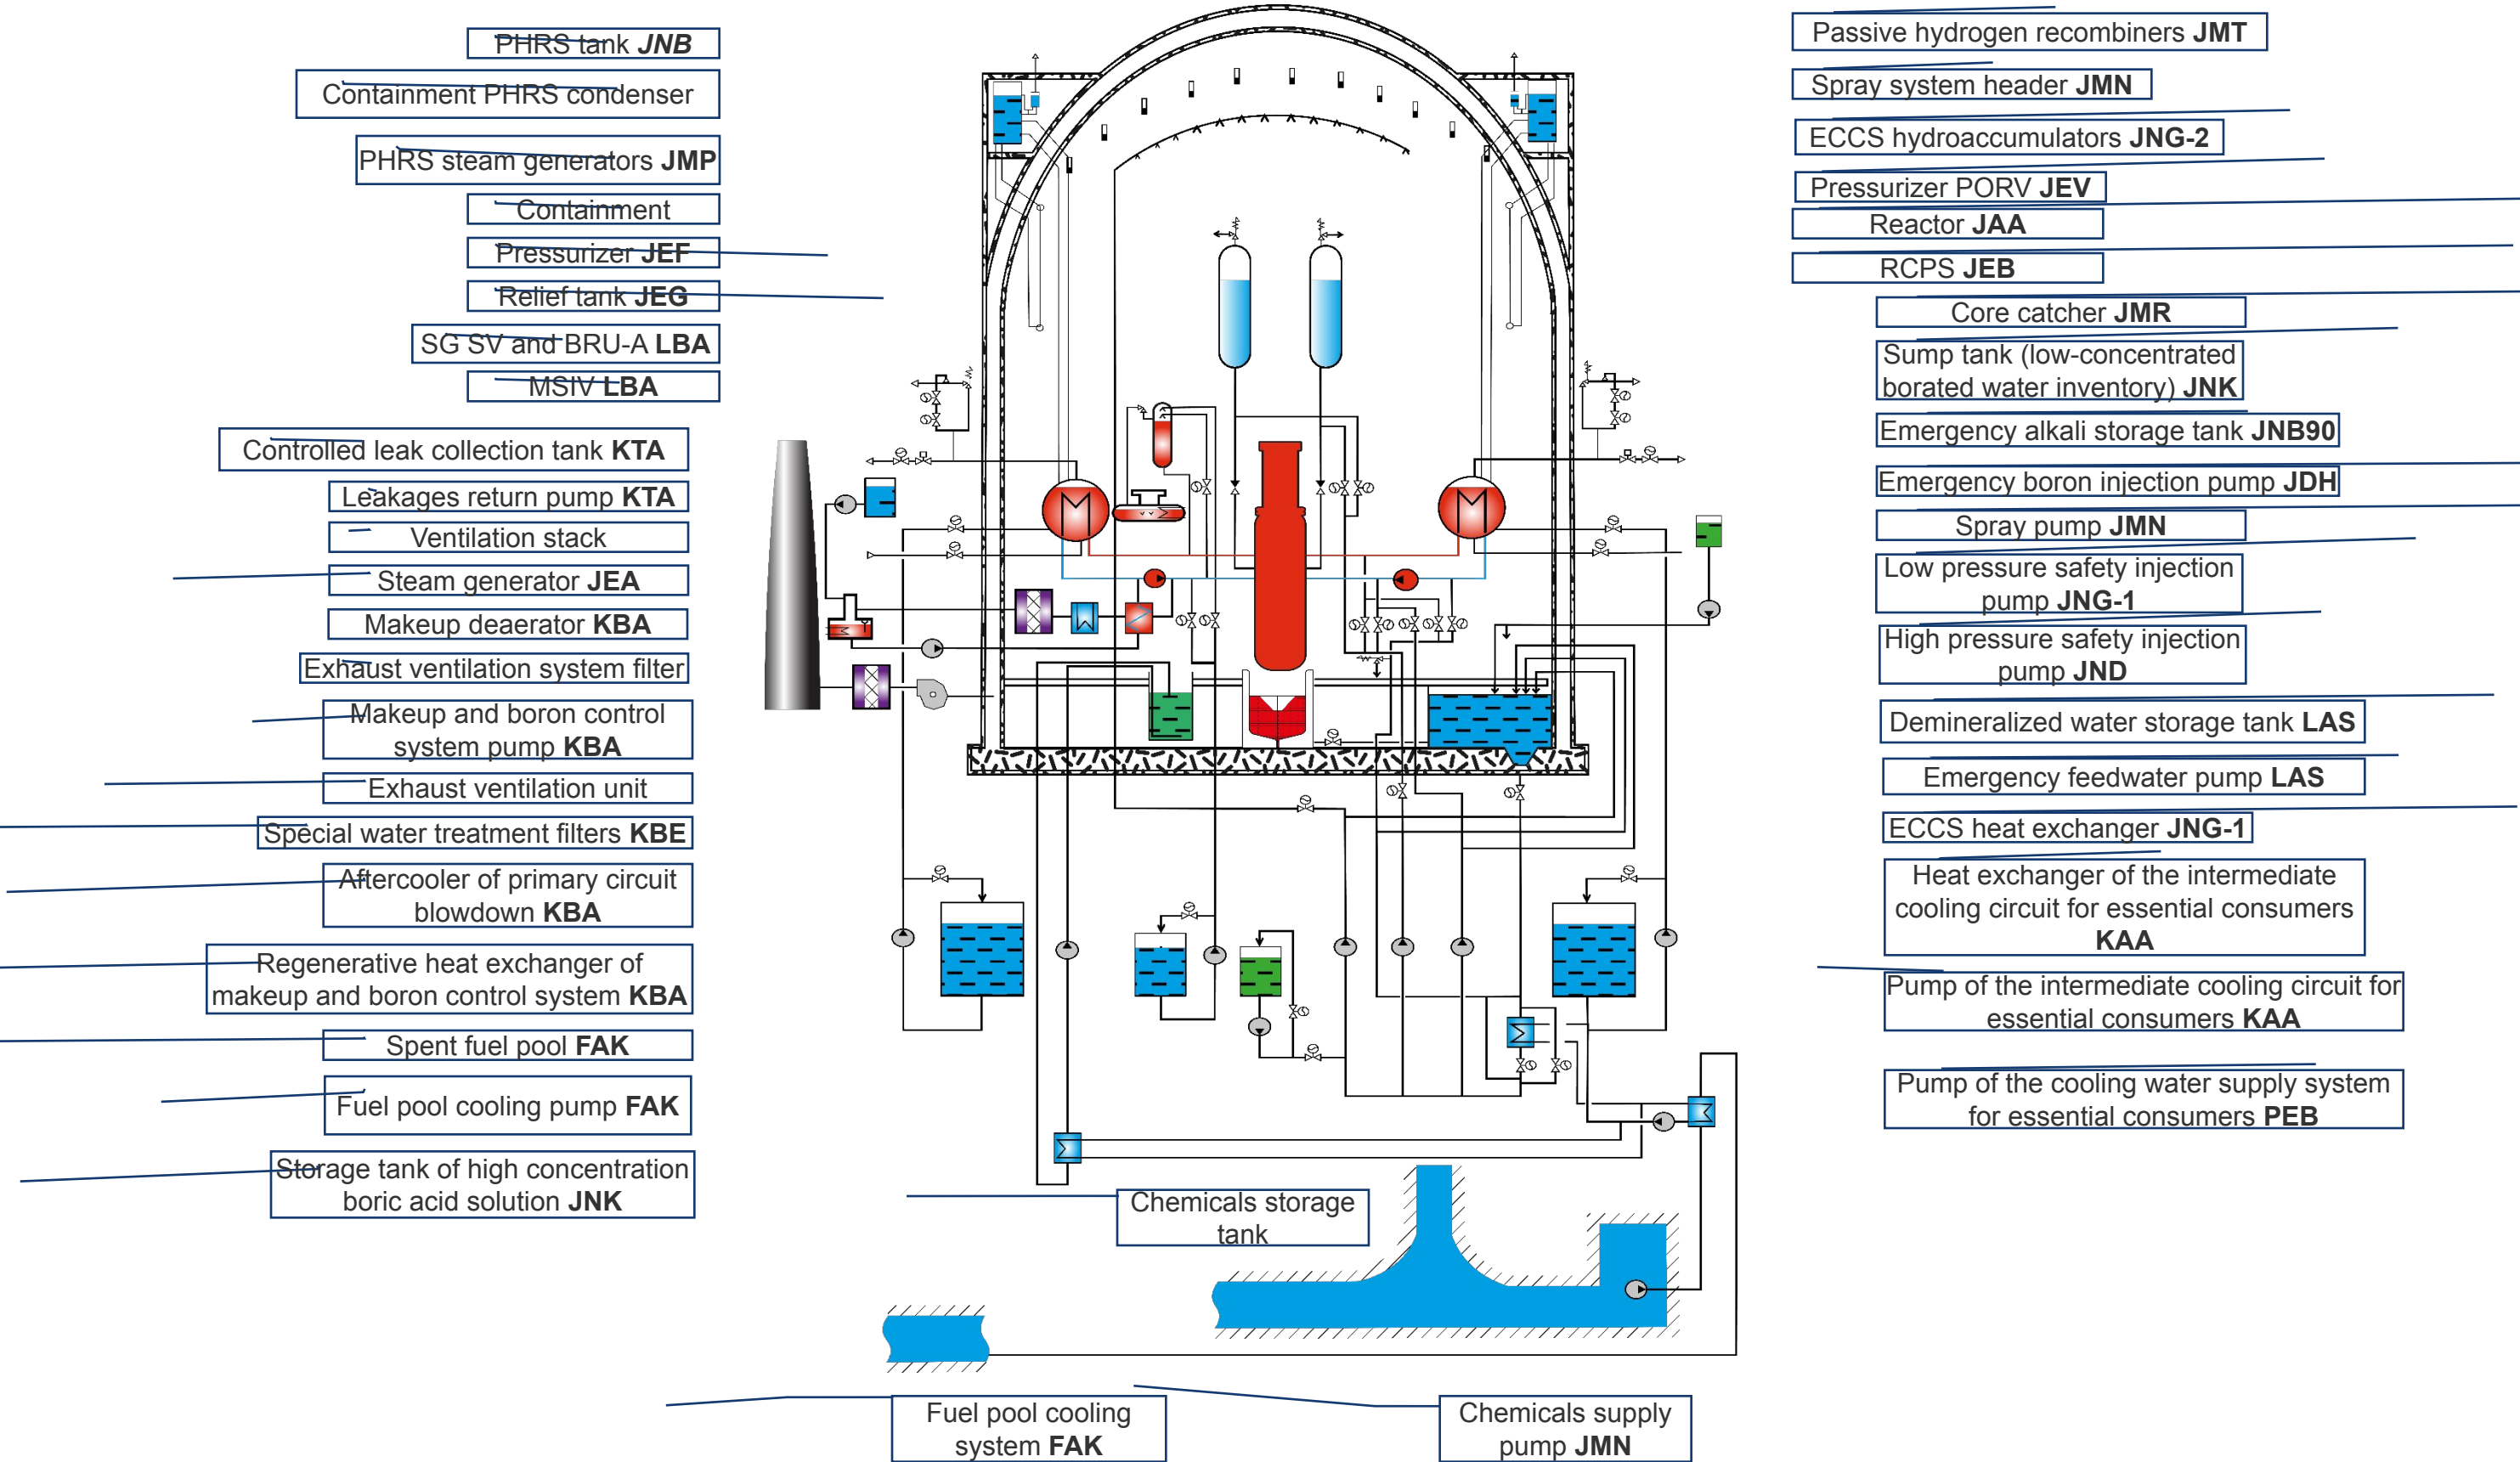



ROSATOM

Rosatom State Atomic Energy Corporation


A. Reactivity control




RUSATOMSERVICE



The NPP design provides for the following means to ensure reactivity control and core subcriticality:

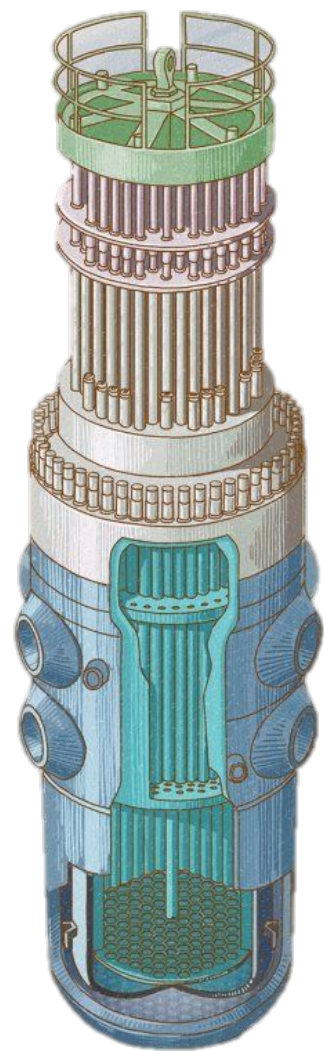

- **CPS rods** – *under emergency conditions CPS rods are transferred into the lower position in response to EP signals and in case of power output loss*

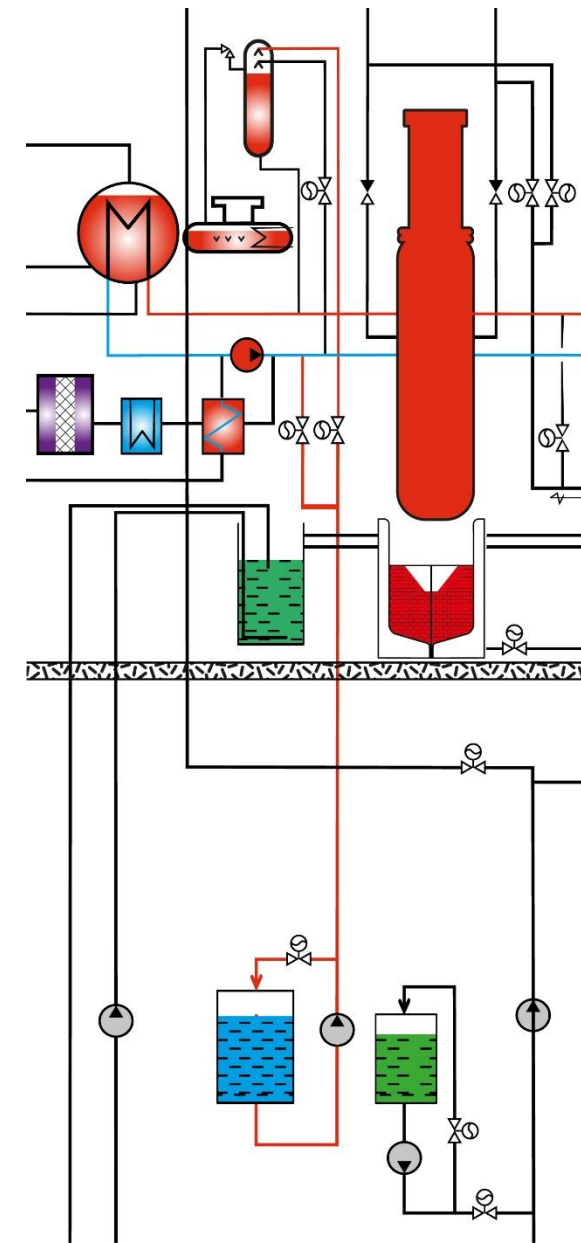

- **Emergency boron injection system JDH** *is designed to bring the core to the subcritical state under conditions relating to CPS CR failure (ATWS)*

- Supplies boric acid solution with the concentration of 40 g/kg and temperature of at least 20 °C at any pressure in the primary circuit within the range of 0.098 ÷ 24.5 MPa
- The system is has a four-train structure. System performance functioning is:
 - *4x33% - functioning in ATWS (DEC)*
 - *4x50% - functioning in PRISE (DBC4)*
- The system includes the following:
 - *plunger pumps*
 - *valves*
 - *pipelines*
- JNK system stores boric acid solution inventory with the concentration of 40 g/l. The design provides for 4 tanks with the operating capacity of 50 m³



ROSATOM

Rosatom State Atomic Energy Corporation

B. Heat removal from nuclear fuel




RUSATOMSERVICE



The design provides for the following systems and means to maintain the coolant inventory and to make up the primary circuit:


- *High pressure safety injection system JND*
- *Low pressure safety injection system JNG-1*
- *ECCS hydraulic accumulators JNG-2*
- *KBB system pumps*

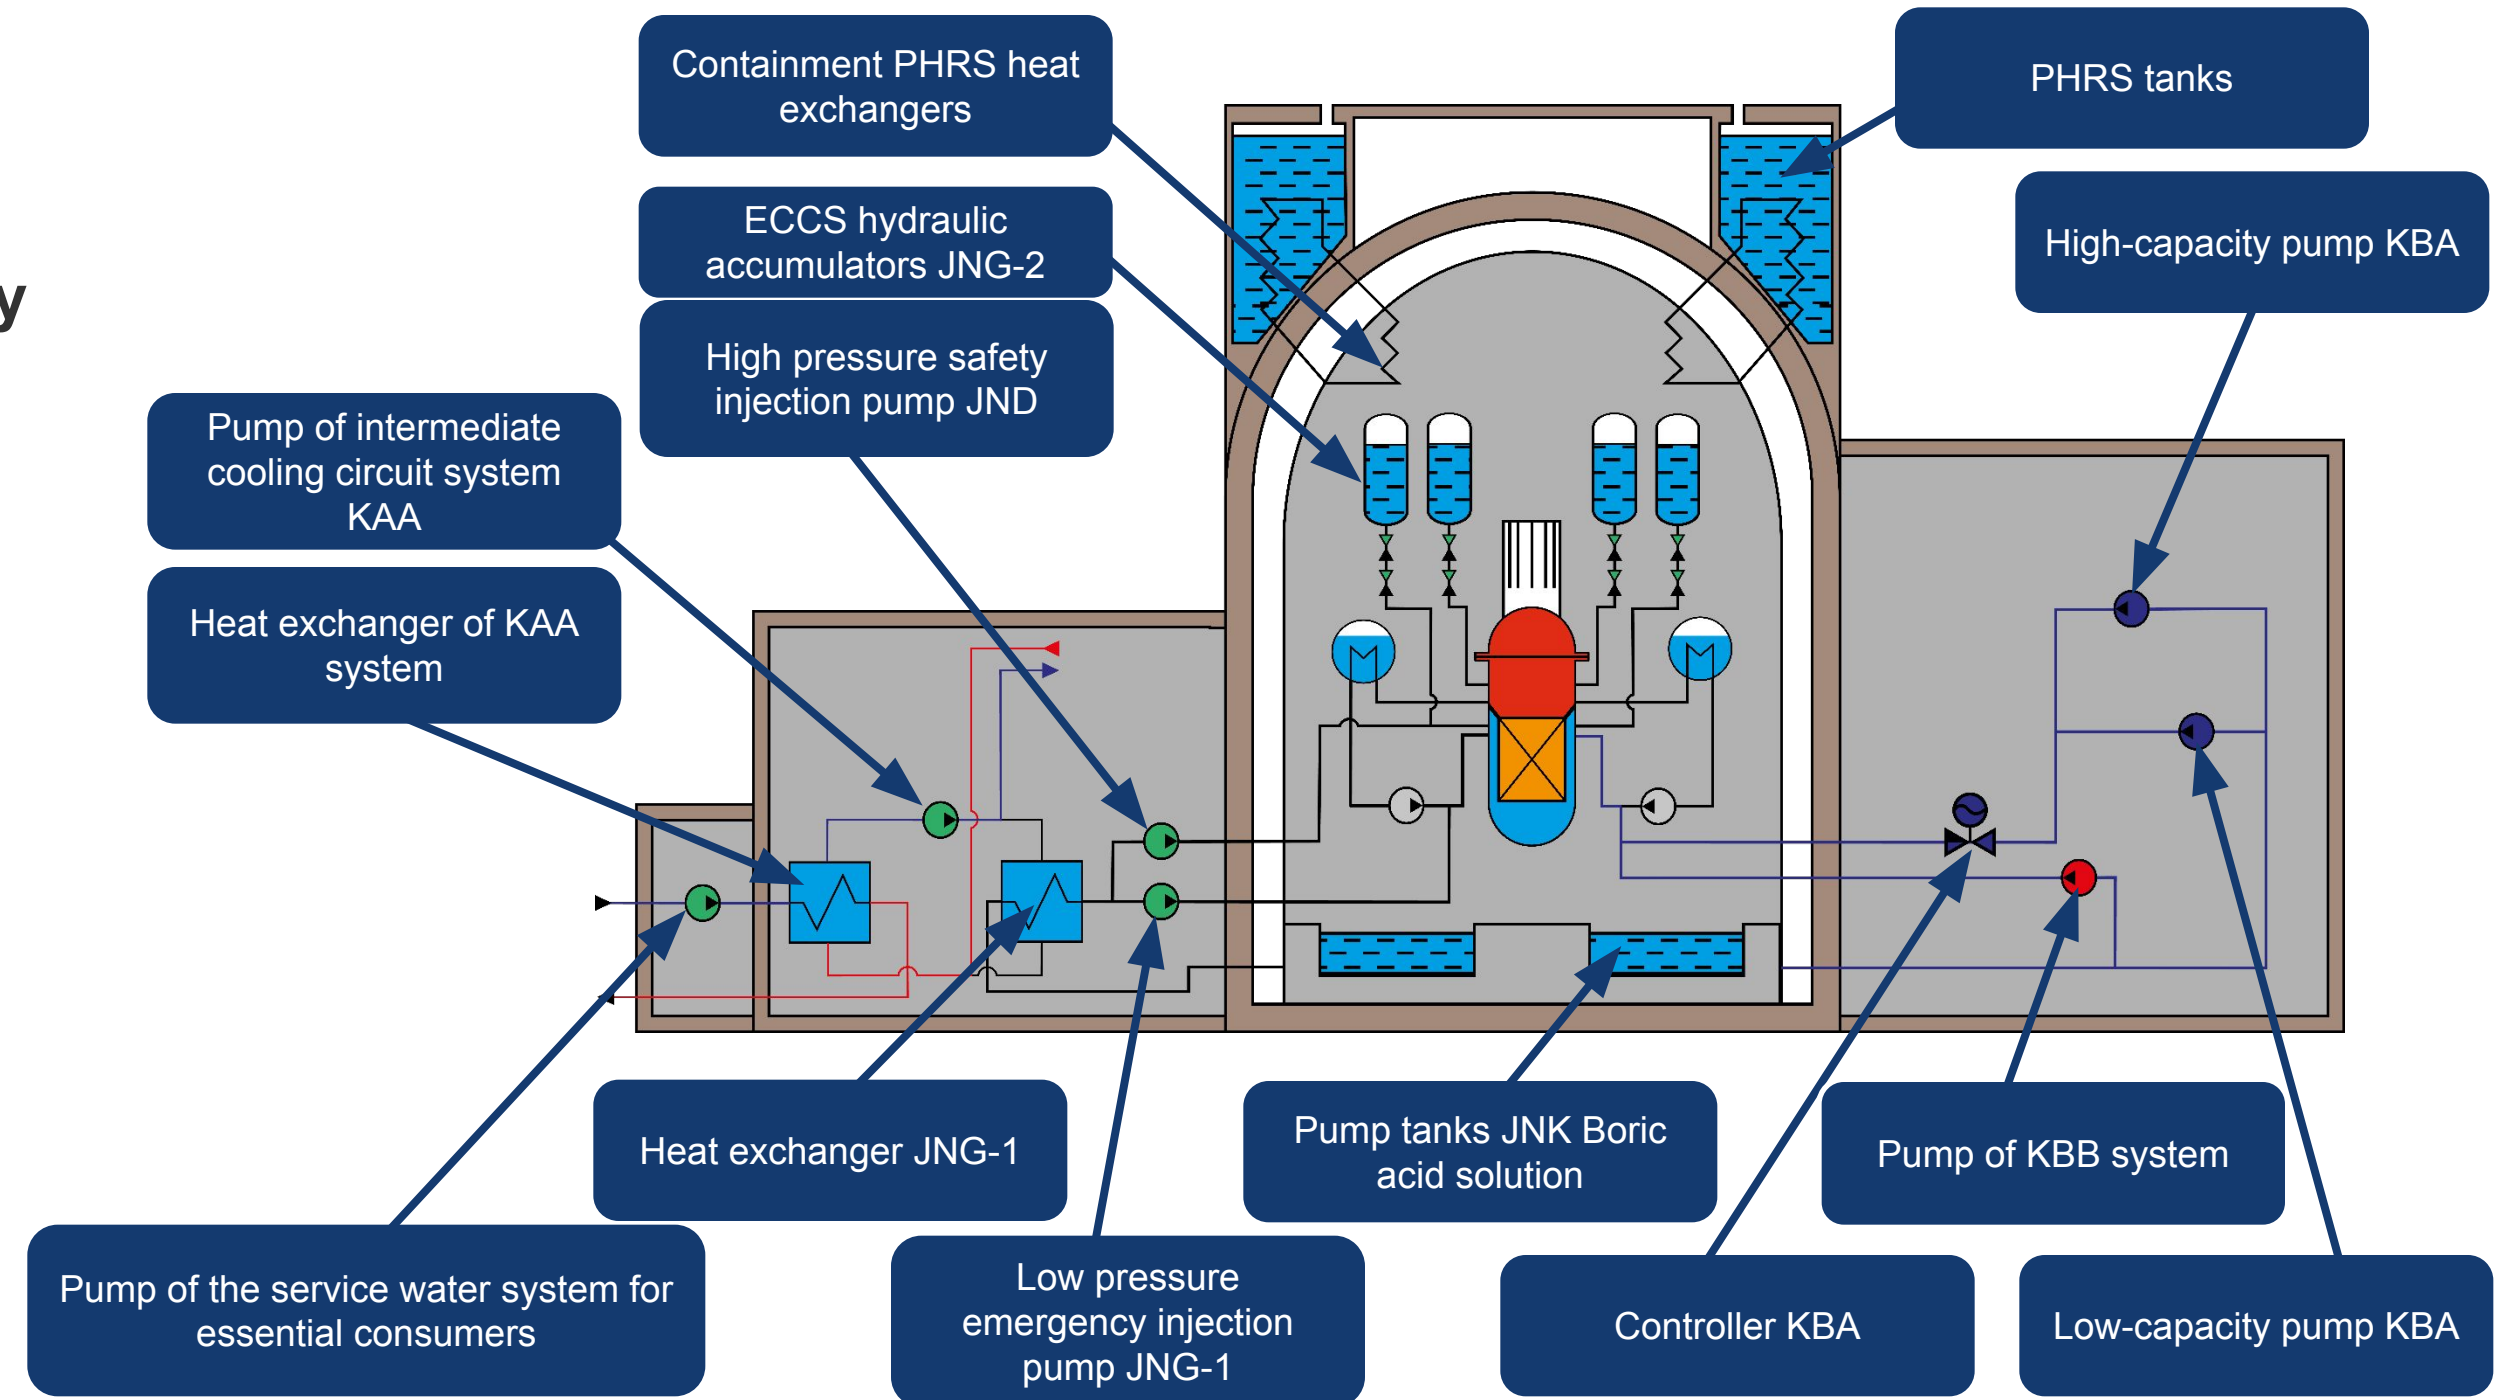

Arrangement of the main systems and means ensuring coolant inventory maintenance and NPP primary circuit makeup

Means ensuring heat removal from the core and RP cooldown to 130 °C:

- BRU-K+AFWP
- BRU-A+EFWP
- SG PHRS

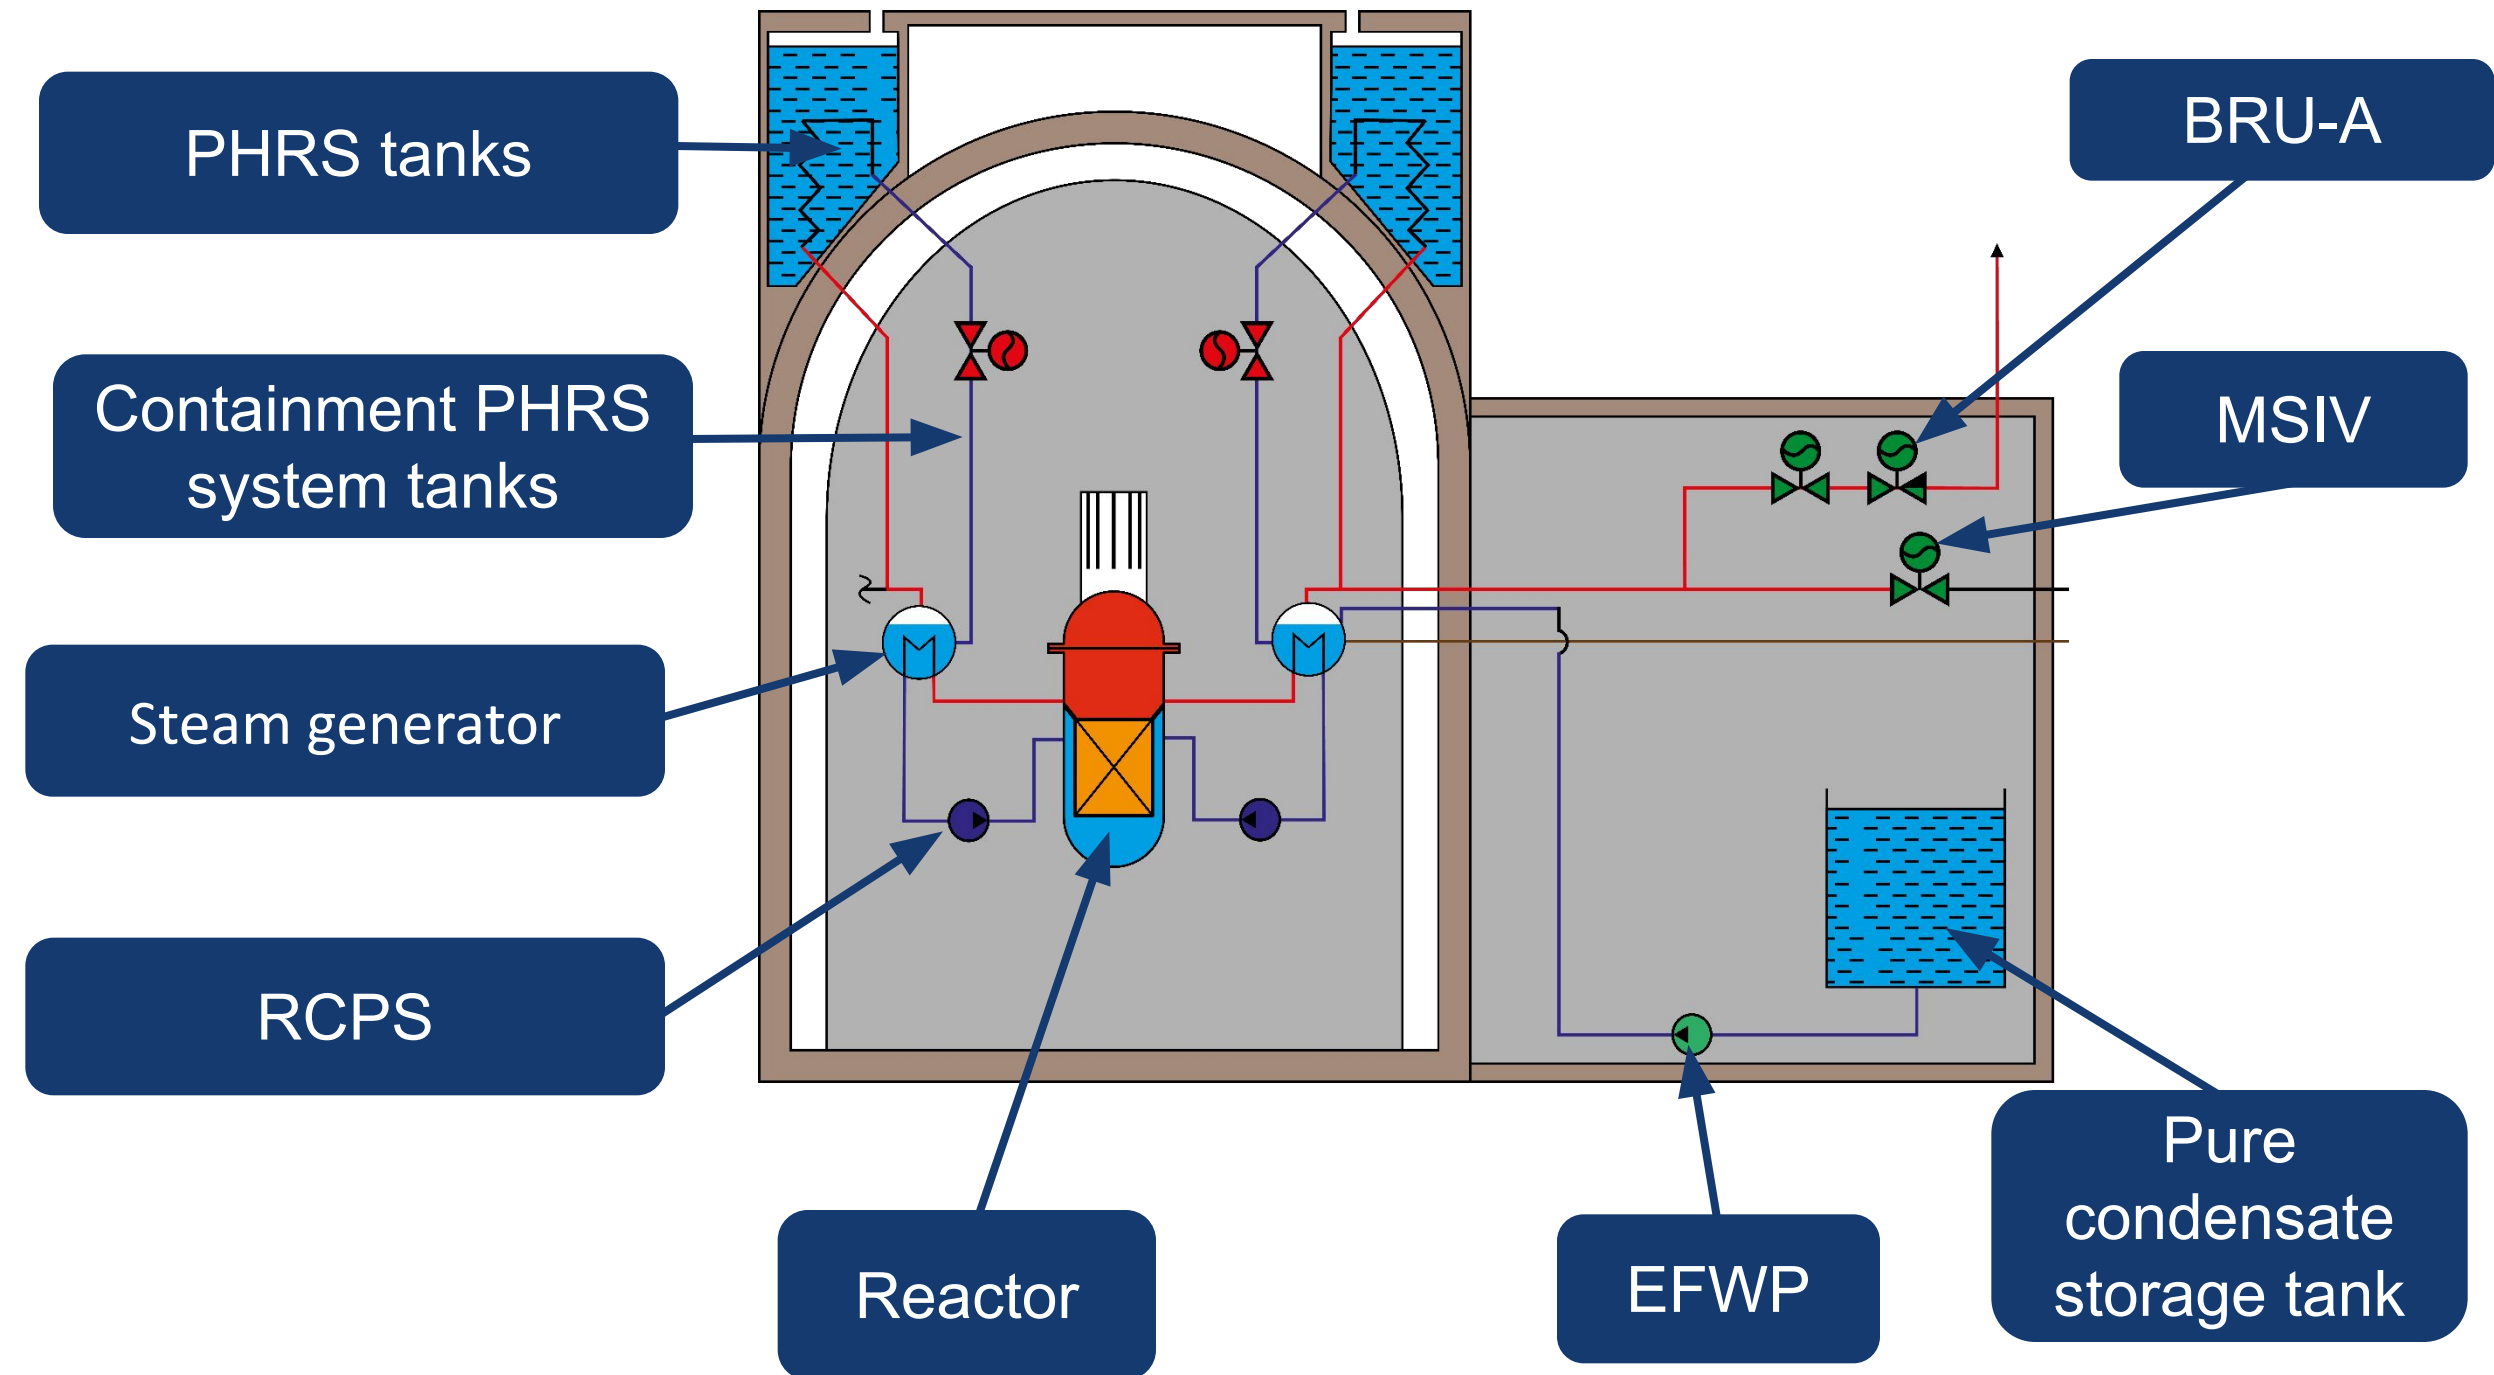


Arrangement of the main equipment ensuring RP cooldown to 130 °C

The system for passive heat removal through steam generators is designed to continuously remove residual heat from the core and cool down the RP to 130 °C in DEC conditions (level 3b).

The system operates for 72 hours without operator participation during accidents with full blackout and SG feedwater failure.

Heat is removed passively through steam lines to EHRT tanks.

The system has a four-train structure.
System functioning efficiency is 4x33 %

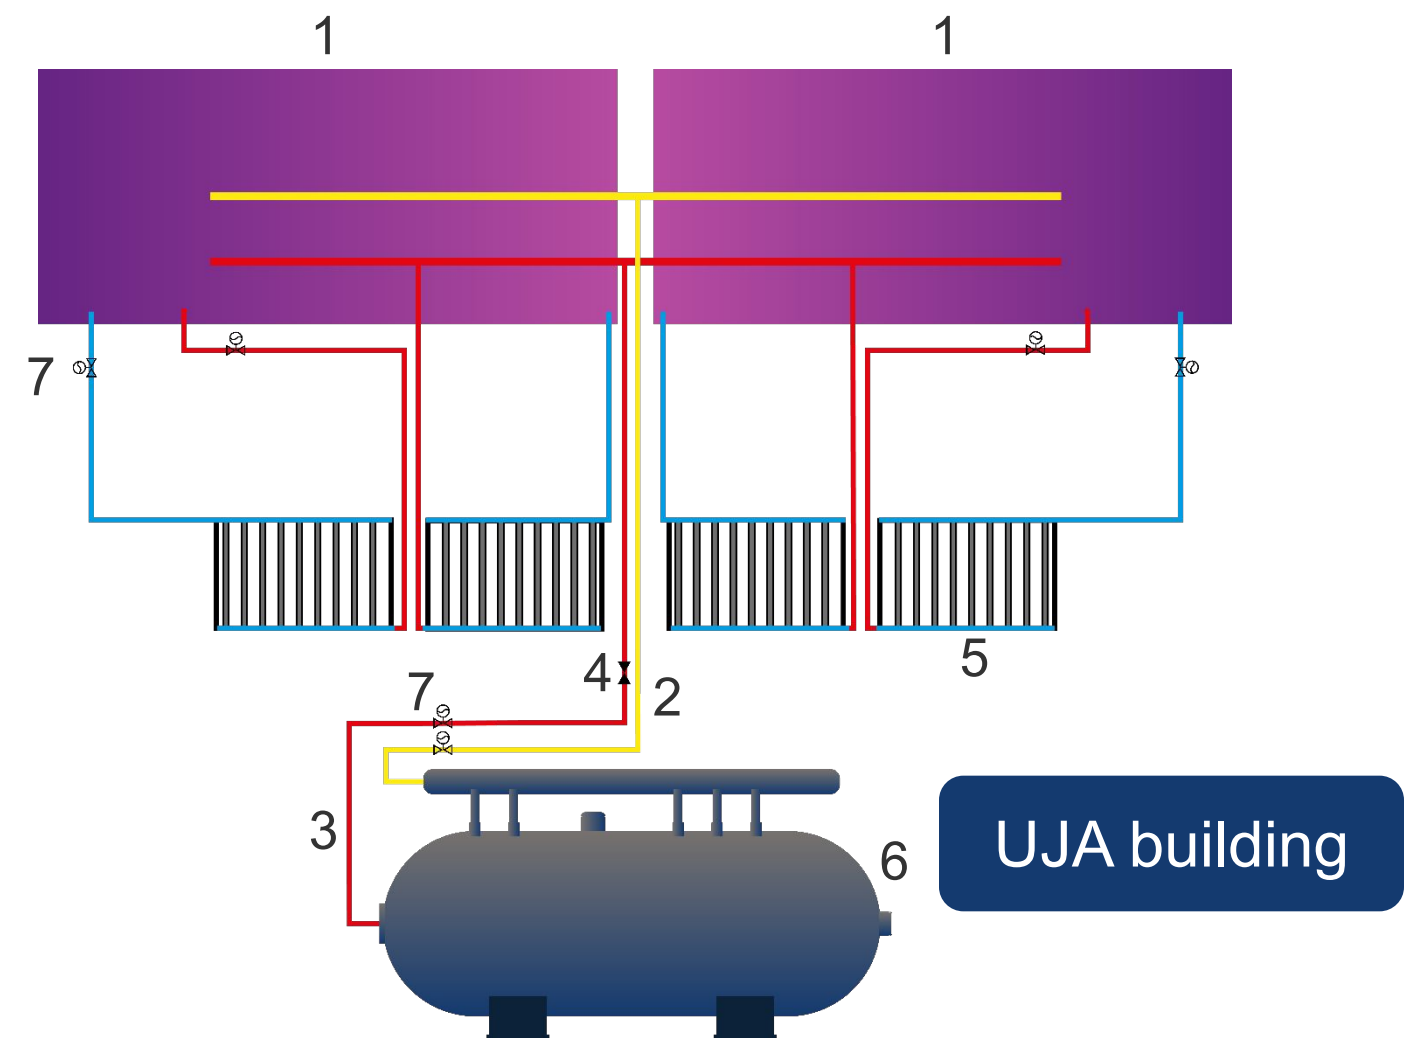


- 1 – emergency heat removal tanks (EHRT)
- 2 – steam lines
- 3 – condensate pipelines
- 4 – SG PHRS valves
- 5 – containment PHRS heat exchangers-condensers
- 6 – steam generators
- 7 – isolation valves

Pressure is reduced in the primary circuit by condensation in the vapor space of the pressurizer by means of injection:

- from RCPS head
- from head of pumps of the makeup and boron control system (KBA)
- by the pump of the emergency boron injection system

The following hardware is provided in the design for pressure relief:

- safety valves of pressurizer and SG
- BRU-A
- safety valves in the residual heat removal system

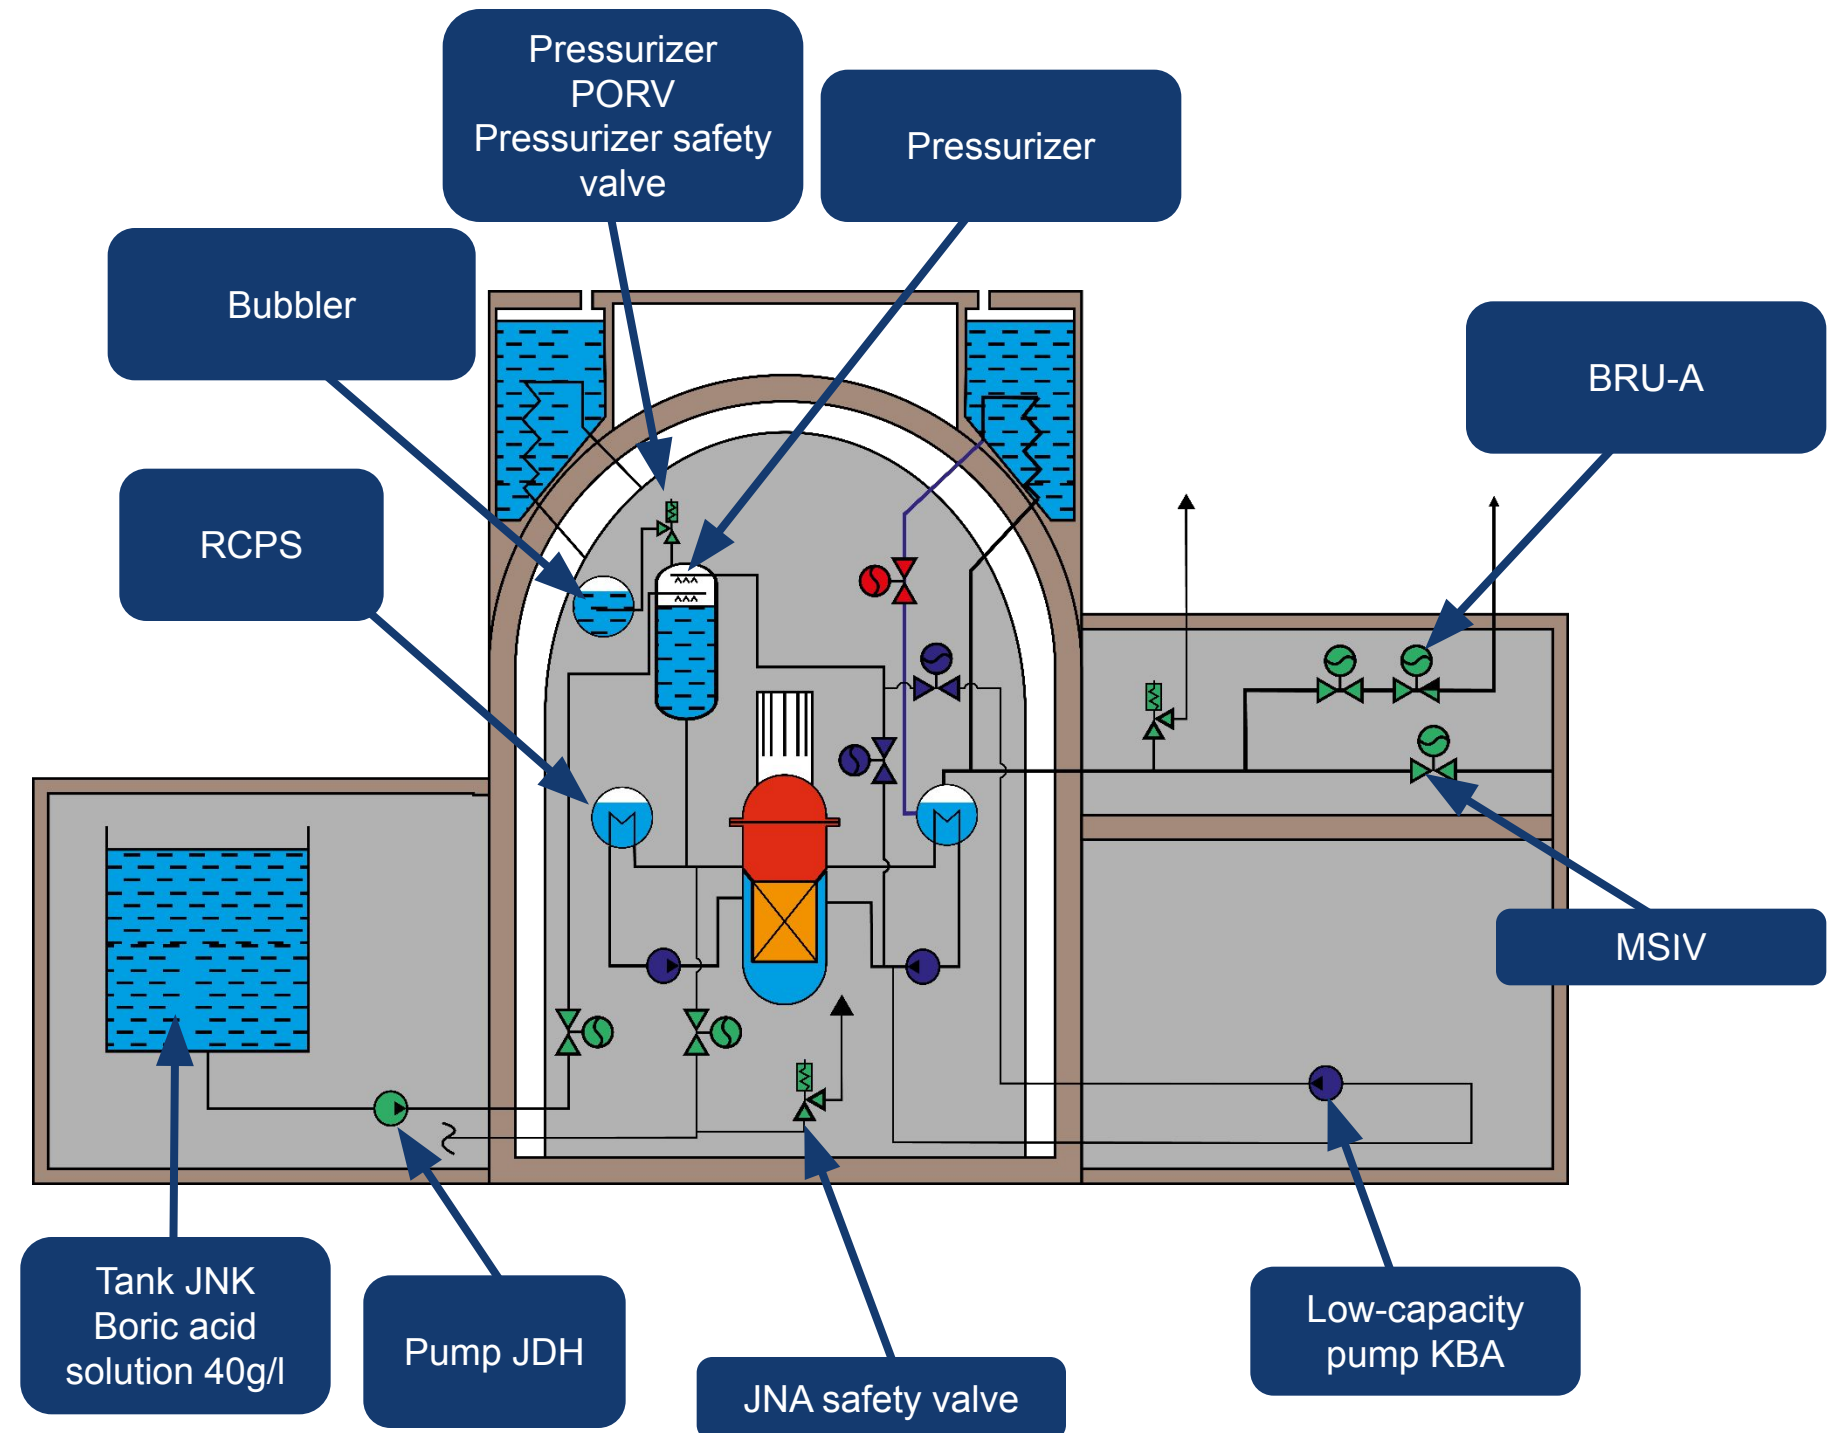

The primary circuit overpressure protection system includes three pilot-operated relief valves, each consisting of the following:

- *main valve*
- *relief valves with pipelines*
- *cutoff valve*
- *spring setting valve*
- *additional control line with three successive valves*

PORV 1 control – actuation pressure: 18.11 MPa.

PORV2, PORV3 operating – actuation pressure: 18.6 MPa.


Steam is discharged into bubbler JEG

The following systems are provided for in the design to remove heat from spent fuel assemblies stored in the spent fuel pool:

- Fuel pool cooling system (FAK)
- JMN/JNG/JNA system

For maintaining water level in the spent fuel pool:

- FAK system pumps
- FAL system pumps
- KBB system pumps
- JMN system pumps

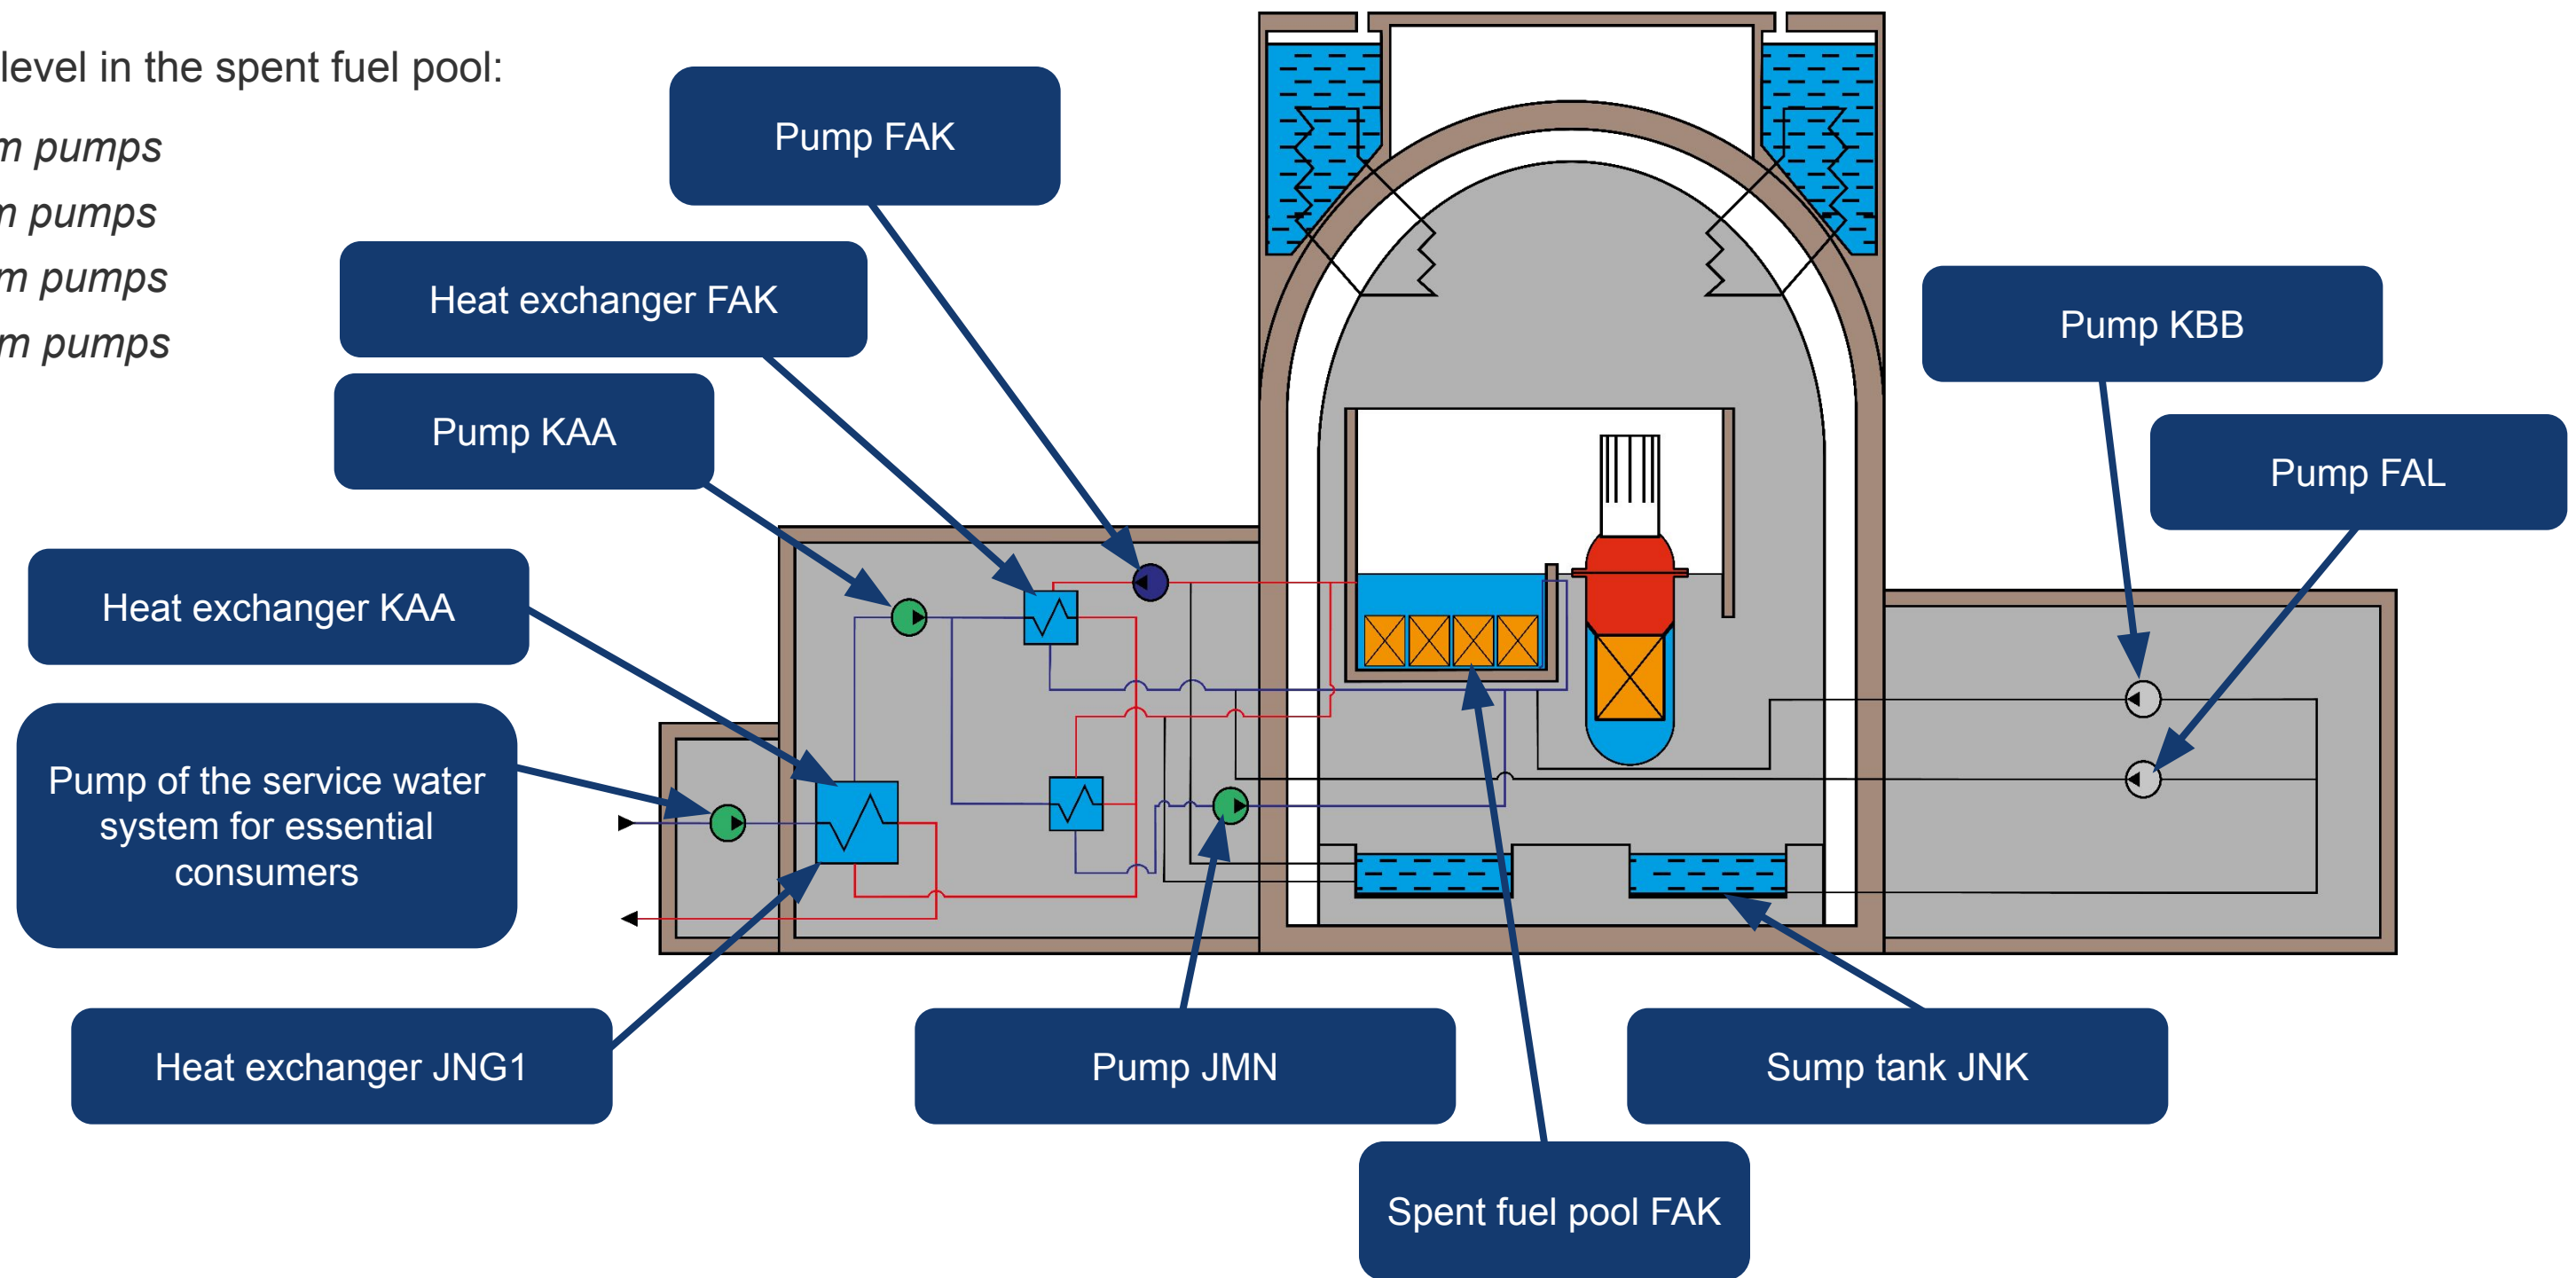



ROSATOM

Rosatom State Atomic Energy Corporation

C. Localization of activity




RUSATOMSERVICE




The following means are provided in the design for heat removal from the containment:


- *spray system JMN*
- *system for passive heat removal from the containment*

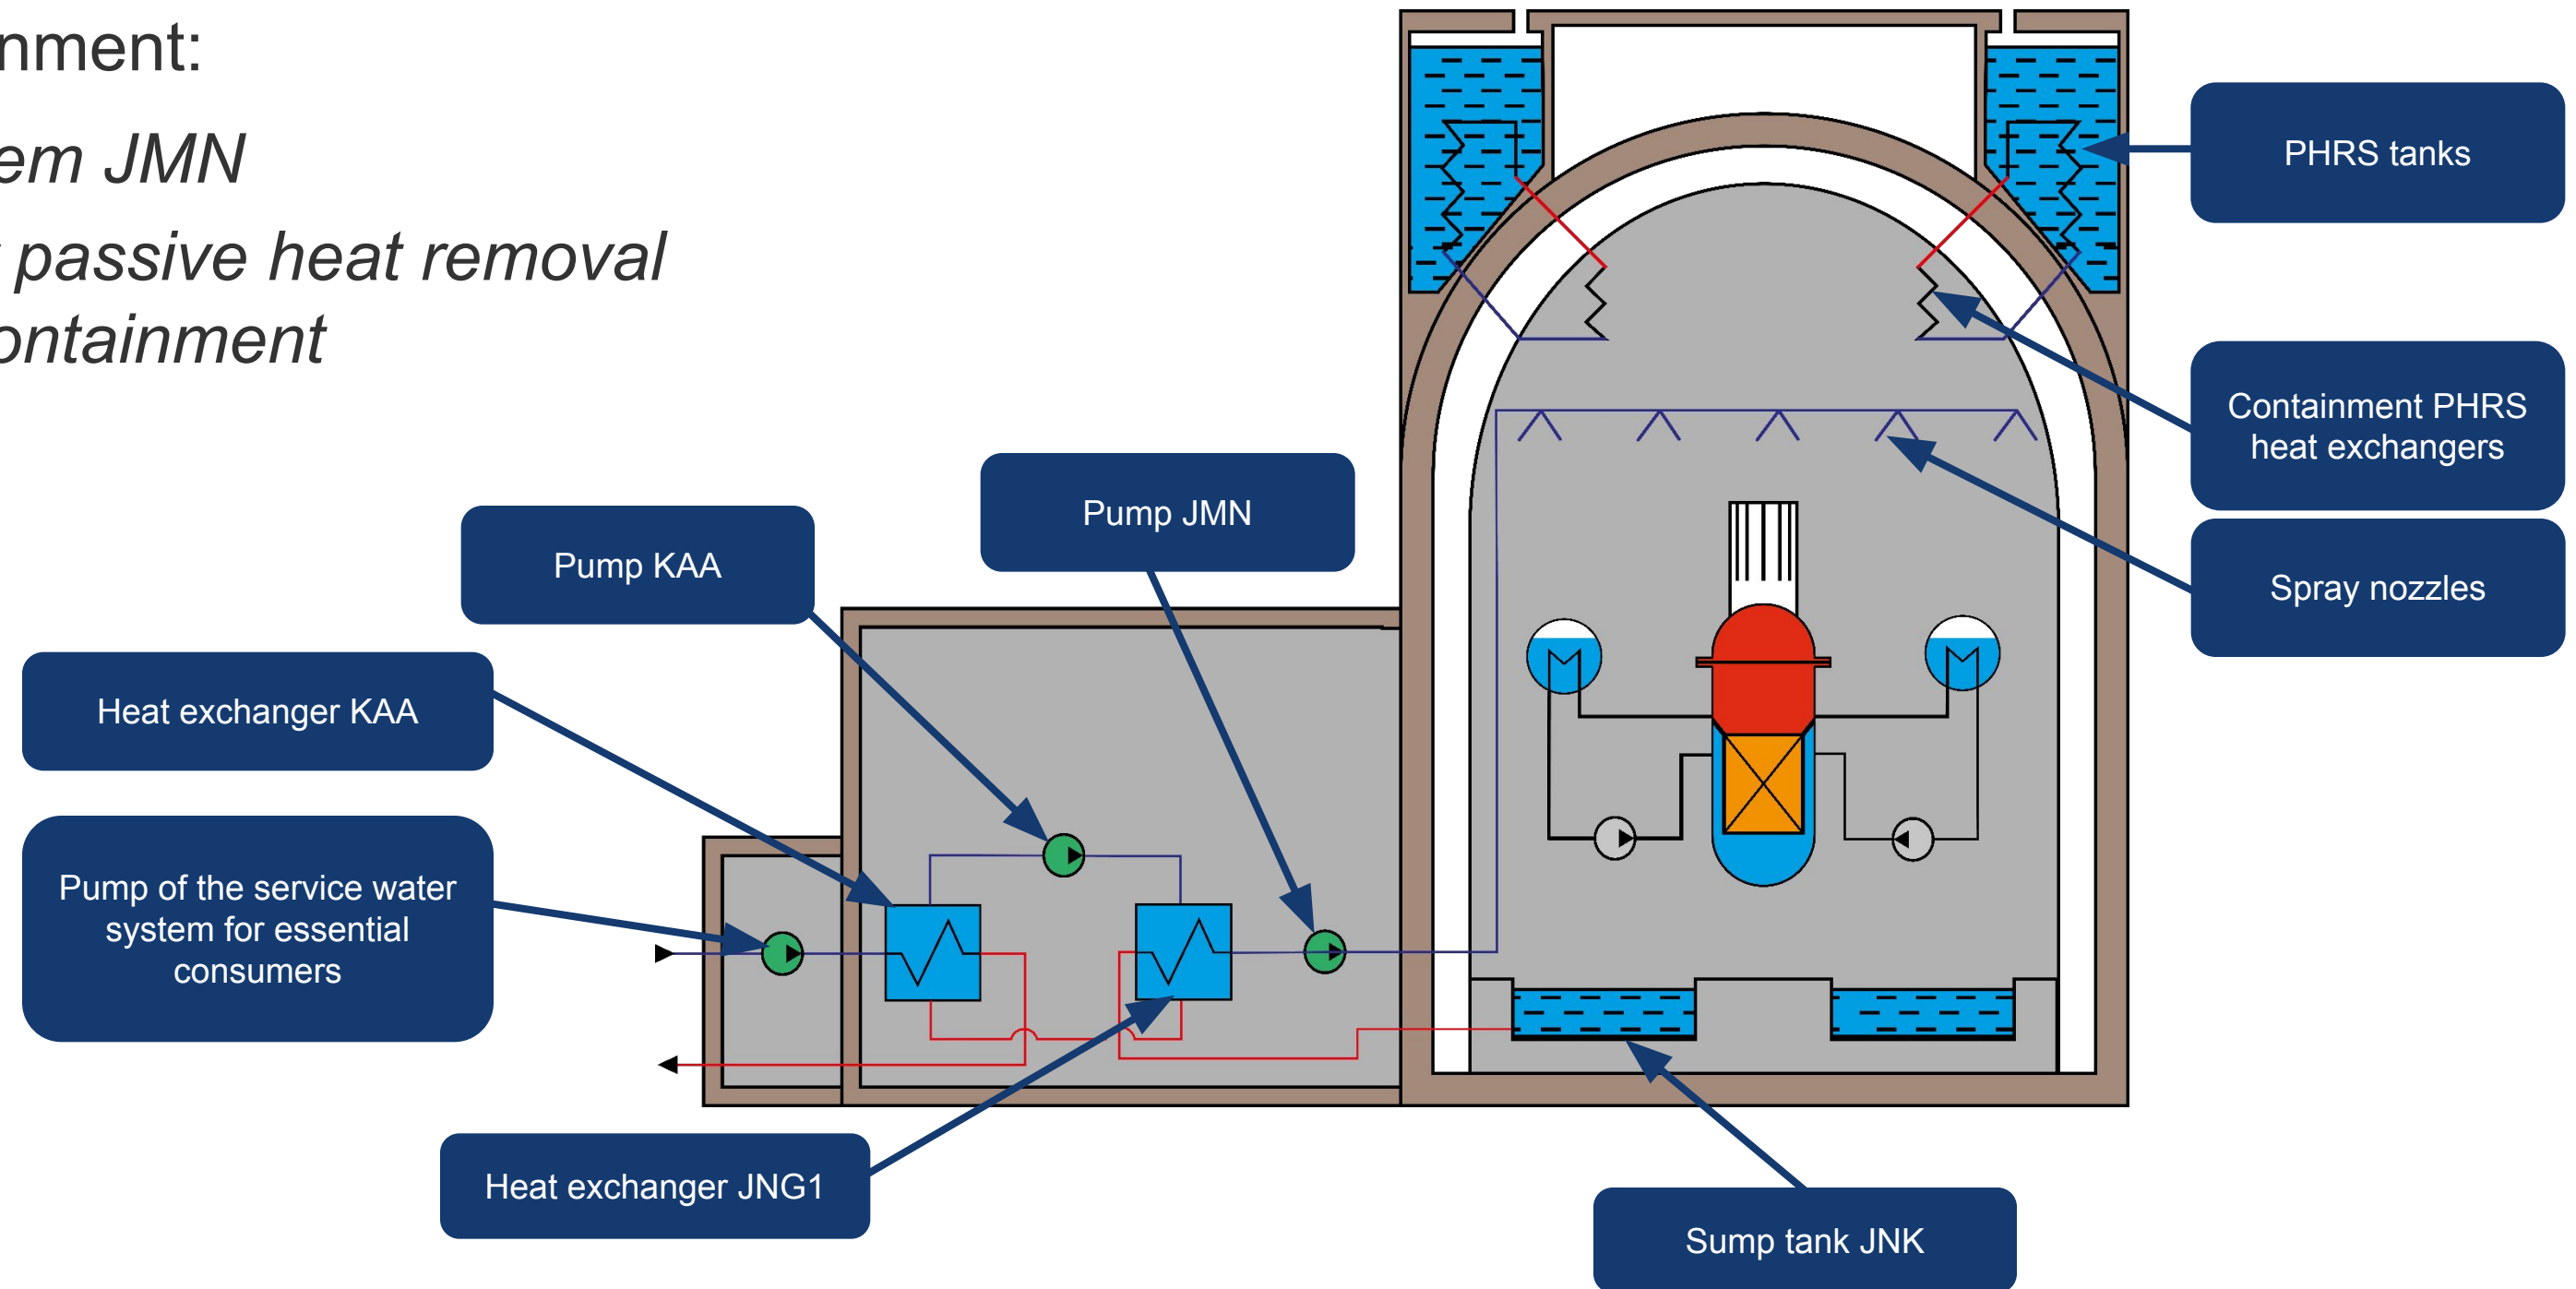

Containment system:

- leak-proof steel liner
- reinforced concrete enclosing structures
- manholes, locks
- penetrations
- isolating devices

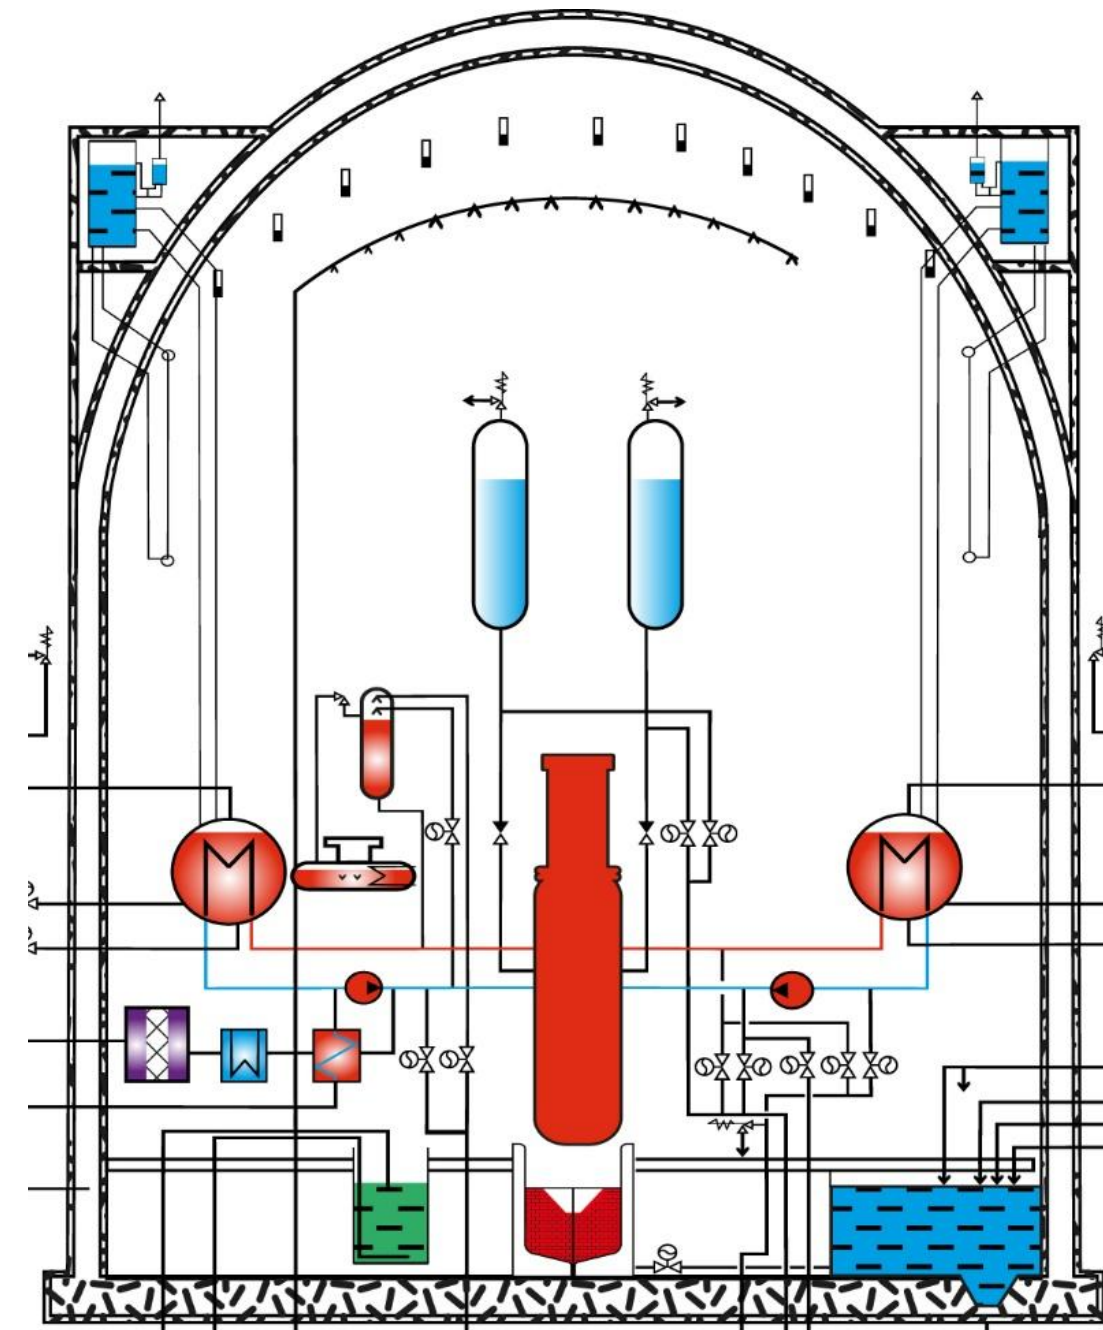

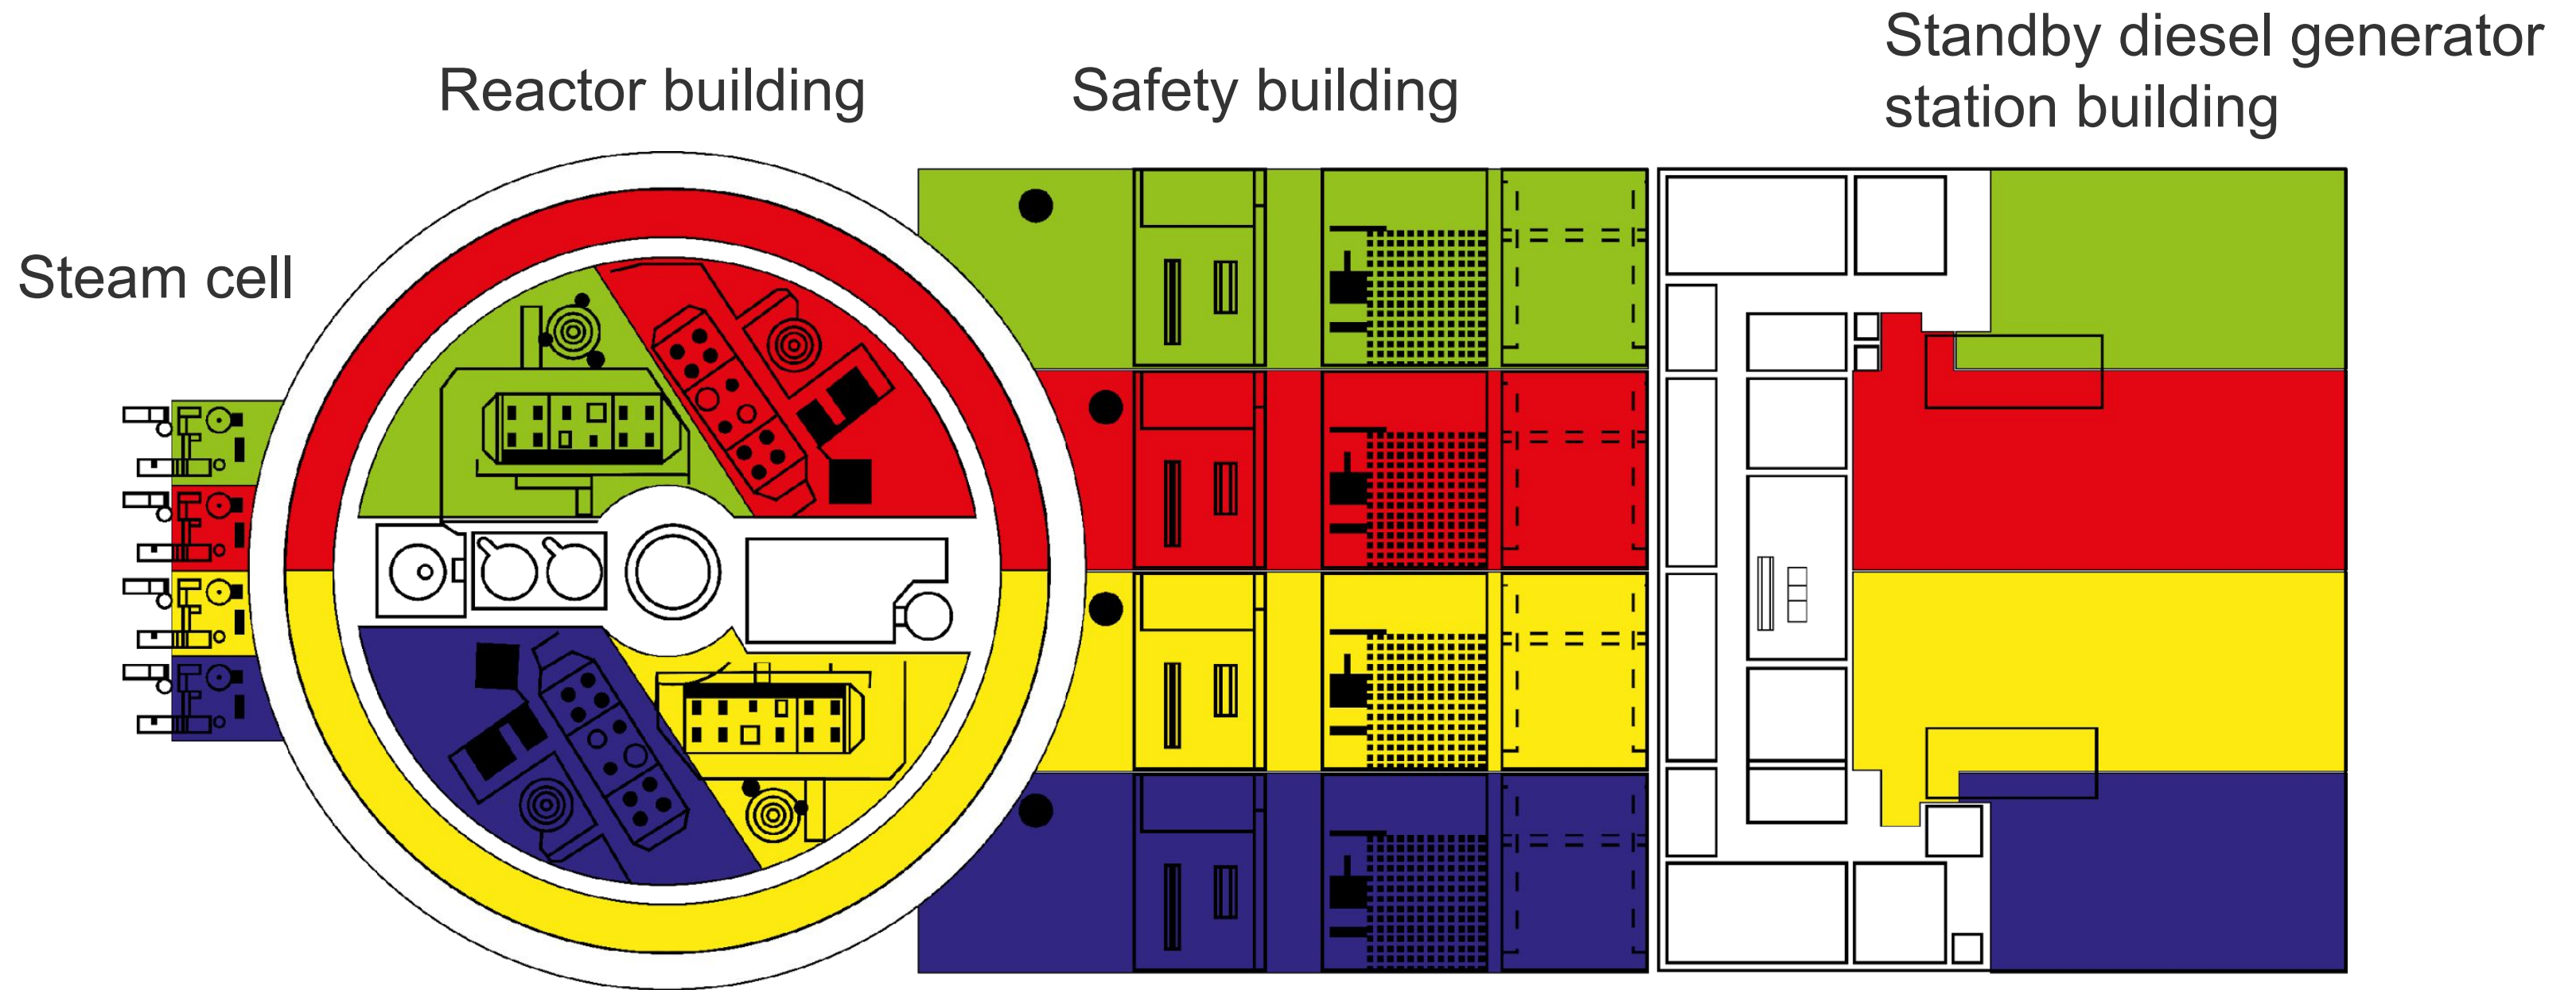

Thank you for your attention!