


#### Welcome to


# S&P USA & the 2012 International Residential and Mechanical Code for Ventilation





#### **Presentation Objectives**

- To understand sections of IRC concerning ventilation
- To understand sections of IMC concerning ventilation
- Identify S&P compliance options












# CHAPTER 15: THE CODE IN REGARDS TO VENTILATION







#### **Sections Requiring Ventilation**

- Clothes Dryer Exhaust (M1502)
- Range Hood Exhaust (M1503)
- Mechanical Ventilation (M1507)
  - Whole-house Ventilation
  - Local Exhaust



#### The Code Specifies:

- 1. The dryer exhaust MUST terminate to the outside
- 2. The MAX. length of the [dryer] exhaust duct is 35' from the connection to the outlet terminal

#### **Problem Created by Code:**

- 1. What if the dryer is NOT located close to the outlet terminal?
- 2. What if the duct is longer than 35' so elbows are necessary creating complicated duct work? (ref. table 1502.4.4.1)

**FACT:** When ducting from a dryer to the outlet is long and/or complicated the dryer cannot overcome the static pressure thus reducing efficiency and causing increased or poor drying time.

#### S&P's Solution:

A Clothes Dryer Booster Fan will help overcome the static pressure created from long and/or complicated duct runs.

#### Section 1502 M1502

#### **PV100X with Current Sensor**

- Centrifugal blade design capable of overcoming extreme resistance (high static pressure)
- Class F insulation
- "Fail-safe" activation method with Current Sensor
- Fan only runs when device senses current





# S.P

#### The Code Specifies:

- 1. Makeup air is required when system is capable of exhausting 400+ CFM
  - 1. Rate of makeup air must be (approx.) equal to the exhaust air

## Why You Need S&P:

Simple...Makeup Air!

#### **S&P's Solutions:**

- **1. GOOD:** TD-MIXVENT (Mixed Flow Fan)
- 2. BEST: TD-SILENT (Mixed Flow Fan)



#### TD MIXVENT: Mixed Flow Fan

- TD-200 with filter box & backdraft damper
  - Meets the requirement
  - Prevents cold air from infiltrating
  - Filters the incoming air
  - Distributes air through a small round grille
  - Brings air in through an aluminum outdoor grille



The TD-200 operates at 2 sones! That's just twice as loud as a refrigerator.









#### TD SILENT: Extremely Quiet Mixed Flow Fan

- TD-200S w/filter box & backdraft damper
  - Meets the requirement
  - Prevents cold air from infiltrating
  - Filters the incoming air
  - Distributes air through a small round grille
  - Brings air in through an aluminum outdoor grille



The TD-200S Silent operates at .5 sones! That's ½ as quiet as a refrigerator.





#### The Code Specifies:

- 1. Whole-house Ventilation AND Local Exhaust is required
- 2. Bathroom & toilet air must be exhausted directly to the outdoors and shall not be recirculated within residence

We will start with the Whole-house Ventilation Requirements

#### Whole-house Ventilation Requirements

- 1. One or more supply or exhaust fans, plus associated ducts and controls
- 2. Local exhaust or supply fans contribute to the whole-house ventilation requirement
- 3. System must have controls that enable manual override
- 4. Outdoor (makeup) air must be provided at a <u>continuous</u> rate (ref. Table 1507.3.3)
  - 1. Exception: if you use controls that enable operation for at least 25% of each 4 hour segment you can operate **intermittently**

#### Section M1507 uses the ASHRAE 62.2 Standards



• Table 1507.3.3: The amount of whole house ventilation that is required to meet the standard.

DWELLING UNIT		NUMBE	R OF BED	ROOMS							
FLOOR AREA	0-1	2 -3	6-7	> 7							
(square feet)	Airflow in CFM										
< 1,500	30	45	60	75	90						
1,501-3,000	45	60	75	90	105						
3,001-4,500	60	75	90	105	120						
4,501-6,000	75	90	105	120	135						
6,001-7,500	90	105	120	135	150						
> 7,500	105	120	135	150	165						

For SI: 1 square foot =  $0.0929 \text{ m}^2$ , 1 cubic foot per minute =  $0.0004719 \text{ m}^3$ /s.

#### PC-Premium CHIOCE Fan (Exhaust) TD-MIXVENT Fan (Supply)

- The PC Fan will run continuously for exhaust
- The TD will provide outdoor air continuously
- A speed control should be used to set the TD to match the PC performance
- You meet the code but don't exceed it!







#### Exhaust Side of Good Solution

S&P

- Install PC fan in hallway or other area away from the living space
- Motors rated for 30,000 hours continuous on
- The extremely low sound levels ensure the PC will not be intrusive
- ENERGY STAR<sup>®</sup> qualification ensures the fan reduces energy consumption without sacrificing performance



Model	CFM	Static Pressure (in W.G.)	Energy Efficiency (CFM/Watts)*	Watts	Power (V/Hz)	Sones	Amps	
PC80	80/60	0.1/0.25	3.0	32	120/60	0.3	.27	
PC110	110/93	0.1/0.25	3.2	36	120/60	0.6	.30	
PC150	150/110	0.1/0.25	3.8	41	120/60	1.1	.34	

\* Energy Star qualified data based on tested air flow and power consumption.


### PC Bonus Feature: Simple Plug-&-Play Speed Control

PCSC option allows you to set the continuous speed requirement. No separate wall control needed!

#### Supply Side of the Good Solution



- Insert TD Fan into the outside air duct
- Set the performance for the whole house requirement and the exhaust requirement totaling the makeup air

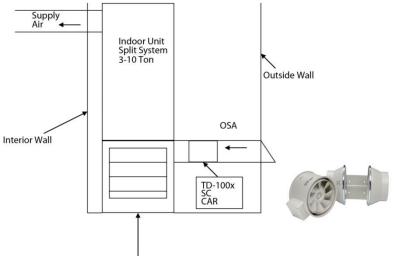

**Return Air Plenum** 

Model	Nom.	Volts	Max.	Sugar		CFN	/ v Static	Pressure	(SP) Ins.	WG		Max.	Max	Wgt.	Duct Dia.	Sama
Moder	RPM	Voita	Watts	Speed	0"	0.125"	0.25"	0.375"	0.5"	0.75"	1.0"	SP	operating temp. (°F)	(lbs)	Ins.	Sones
TD-100	2431	120	23	LS	97	81	51	8 <b>.</b>		879	-	.4	104	2	4"	1,1
10-100	2516	120	26	HS	101	85	57	-	-	-	-	.4	104		4"	
TD 100.	1556	120	20	LS	100	77	48	-	-	-	-	.375	104		4"	
TD-100x	2096	120	33	HS	135	113	90	53	-	-	-	.55	104	1 1	4"	1.7
TD-125	1633	120	24	LS	149	110	73	1440 a.	14			.35	104	1 [	5"	2.1
	2146	120	38	HS	197	168	133	86	22		2	.55	104	4.4	5"	2.1
TD (50	1709	120	54	LS	218	193	163	128	105	24	-	.8	140	] [	6"	2.8
TD-150	2289	120	65	HS	293	273	250	227	206	131	35	1.15	140	1 1	6"	
TD 000	2322	120	139	LS	476	422	373	317	260	40	-	1.38	140		8"	4
TD-200	2781	120	184	HS	538	495	458	418	367	190	10	1.625	140	8.8	8"	
TD 050	2400	115	162	LS	541	475	418	355	295	218	170	2.03	140		10"	
TD-250	3200	115	241	HS	754	715	680	640	606	520	405	2.53	140	19.8	10"	5
TD 245	2000	115	208	LS	751	670	545	420	285	190	130	1.62	140	20.0	12.4"	
TD-315	2500	115	335	HS	1050	990	932	850	770	600	420	2.95	140	30.9	12.4"	6.8



#### TD-SILENT: REQUIRES 2 FANS

- Exhaust Fan set at the required airflow for installed in hallway
- Supply Fan in the outside air duct set at the requirement for Kitchen Ventilation, Bathroom Ventilation, & Whole House ventilation.



Model	Nom. RPM	Volts	Max.	Speed	CFM v Static Pressure (SP) Ins. WG							Max.	Max operating	Wgt.	Duct Dia.	Sones
moder			Watts	opeeu	0"	0.125"	0.25"	0.375"	0.5"	0.75"	1.0"	SP	temp. (°F)	(lbs)	Ins.	
	2000	120	21	LS	108	82	48	-	37	3.75		0.4	104		4"	0.6
TD 100YO	2500	120	35	HS	143	121	91	59	23	-	1.12	0.6	104	11.0	4"	
TD-100XS	2000	120	21	LS	147	110	63	-	27	375	1.5	0.4	104	11.9	5"	
	2500	120	36	HS	203	175	138	84	33	-		0.6	104		5"	
TD 4500	2200	120	55	LS	239	209	181	154	120	62	-	0.95	140	12.2	6"	0.5
TD-150S	2700	120	65	HS	333	315	286	271	257	178	77	1.2	140	13.2	6"	
TD 2000	2000	120	115	LS	409	367	333	306	271	183	46	1.2	140	10.2	8"	0.5
TD-200S	2200	120	122	HS	530	503	472	443	415	349	204	1.2	140	19.2	8"	




#### TR: Energy Recovery Ventilator OR HR: Heat Recovery Ventilator


- Use ERV or HRV to bring in the outside air AND exhaust the air to meet the requirement
- With S&P TR or HR the exhaust and supply air do not mix in the core
- No need to worry about bathroom air cross contamination so it meets the code (see following sides for airflow animation)





odel	ESP (Inches H <sub>2</sub> O)	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0	Specifications		
C	Airflow (CFM)	113	98	85	73	58	40	-	-	-	-	Electrical: 120 V. 60 Hz, Single Phase,		
TR90/TR90G	Watts	41	43	41	44	40	37	-	-	-	-	contains two 0.03Hp, 0.16 FLA motors		
E	Temp Eff %	61	64	67	69	72	76	-	-	12	12	Dimensions: unit case=18W x 23-1/8H x 11-5/8D		
290	Total Winter %	55	58	61	63	66	70	-	-	-	-	carton=21-1/2W x 28-1/2L x 14-3/4H Weight:		
F	Total Summer %	42	46	49	53	57	61	10.70	5	1050	.5	unit=36 lbs, in carton=41 lbs		
	Airflow (CFM)	148	141	132	113	94	69	52	-	-	-	Electrical: 120 V, 60 Hz, Single Phase, 1.3 FLA,		
0	Watts	138	132	125	118	110	98	92	-	-	-	contains one 0.1 hp motor		
TR 130	Temp Eff %	67	68	70	73	76	80	83	-	-	-	Dimensions: unit case=28-3/4W x 20-1/8H x 13D, carton=21W x 32L x 17-1/2H Weight:		
F	Total Winter %	57	59	60	64	67	72	75	-	-				
	Total Summer %	41	43	44	48	52	57	60	-	-	-	unit=58 lbs, in carton=65 lbs		
	Airflow (CFM)	207	192	186	176	168	149	122	-	1	-	Electrical: 120 V, 60 Hz, Single Phase, 1.5 FLA,		
0	Watts	185	169	165	154	148	138	128	-	-	-	contains one 0.1 hp motor		
TR200	Temp Eff %	76	77	77	78	79	80	82	5	100	σ	Dimensions: unit case=28-3/4W x 20-1/8H x 23-7/8D		
F	Total Winter %	67	68	68	69	70	72	74	-	-	-	carton=21-1/2W x 32L x 29H Weight:		
	Total Summer %	52	52	53	56	55	56	59	-	-	-	unit=80 lbs, in carton=88 lbs		
	Airflow (CFM)	-	-	-	310	300	289	268	249	199	155	Electrical: 120 V, 60 Hz, Single Phase, 3.3 FLA,		
0	Watts	-	-	-	310	300	287	266	247	224	206	contains one 0.2 hp motor		
TR300	Temp Eff %	-	-	-	67	68	69	71	72	76	80	Dimensions: unit case=28-3/4W x 20-1/8H x 23-7/8D		
F	Total Winter %		1	1.2	56	57	58	61	62	67	70	carton=21-1/2W × 32L × 29H Weight:		
	Total Summer %		-		37	38	39	42	44	48	51	Weight: unit=72 lbs, in carton=85 lbs		


Model	Airflow Performance (CFM)	Collar System	Port Location	Variable Speed	Motor Warranty	Dimensions	Weight (approx.)
HR100V	30-100 CFM (14 L/s-47 L/s)	5"Oval Dia. (127 mm)	Тор	Yes	5 years	18"x 20"x 14-1/2" (45.7 cm x 50.8 cm x 36.8 cm)	40 lbs. (18.6 Kg)
HR160H	30-160 CFM (14 L/s-76 L/s)	6"Round Dia. (152 mm)	Side	Yes	5 years	21-1/2"x 23-7/8"x 11-3/8" (54.6 cm x 60.6 cm 28.9 cm)	48.5 lbs. (22 Kg)
HR220H	50-220 CFM (24 L/s-104 L/s)	6"Round Dia. (152 mm)	Side	Yes	5 years	21-1/2"x 23-7/8"x 16-1/2" (54.6 cm x 60.6 cm x 41.9 cm)	58.5 lbs. (26.5 Kg)

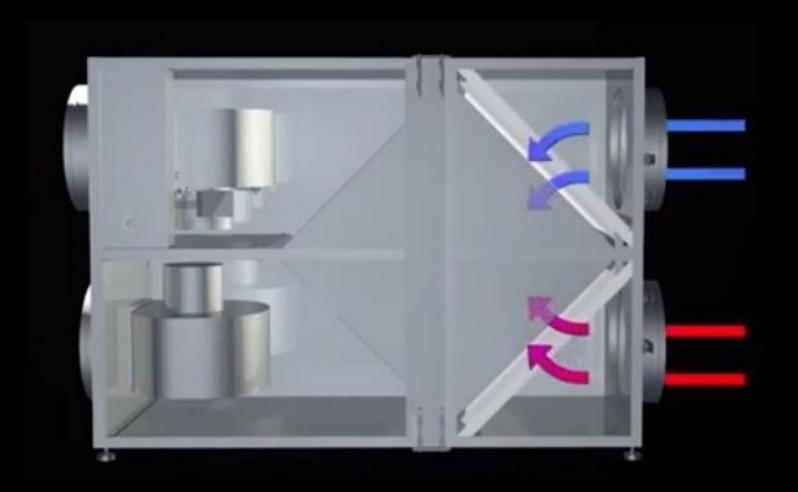

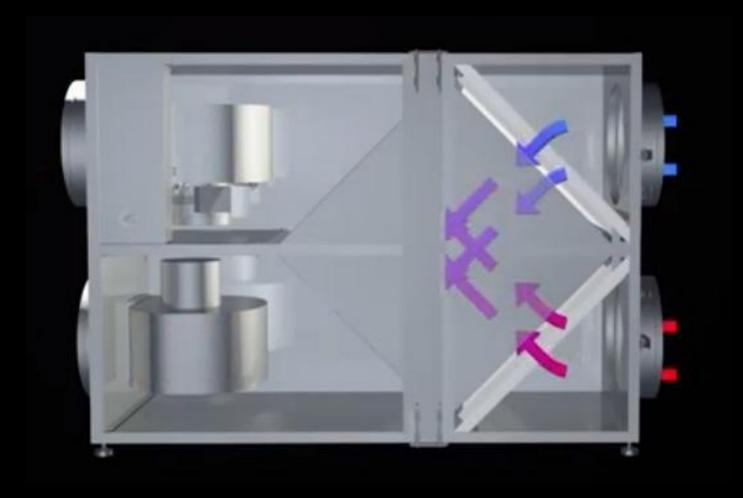

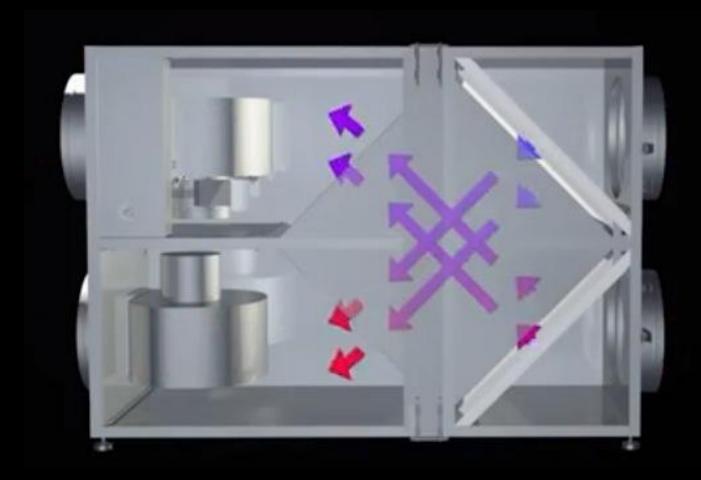

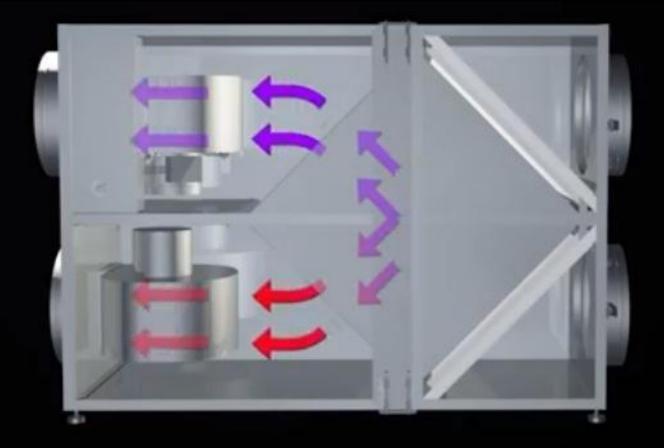

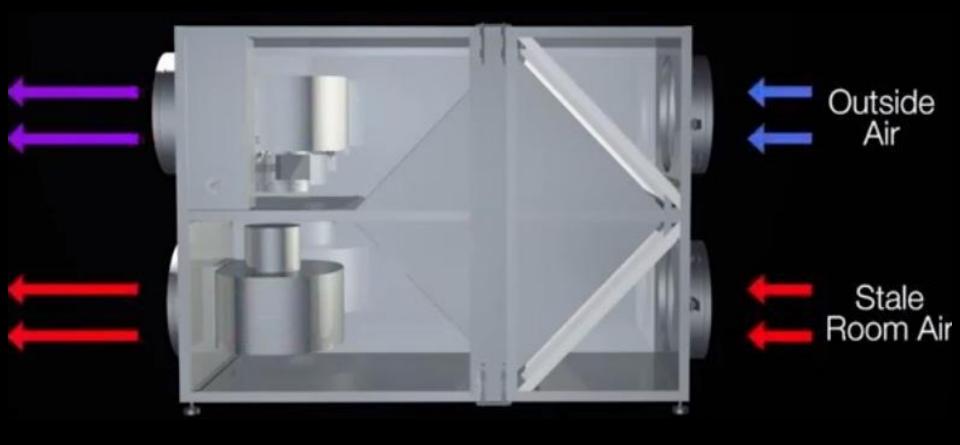



#### Whole-house Ventilation Requirements **EXCEPTION**

• **Exception:** The whole-house mechanical ventilation system is permitted to operate intermittently where the system has controls that enable operation for not less than 25-percent of each 4-hour segment and the ventilation rate prescribed in Table M1507.3.3(1) is multiplied by the factor determined in accordance with Table M1507.3.3(2).



#### **EXCEPTION**: Whole-house Ventilation Specifies:

- Outdoor (makeup) air must be provided at a <u>continuous</u> rate (ref. Table 1507.3.3)
  - 1. Exception: if you use controls that enable operation for at least 25% of each 4 hour segment you can operate <u>intermittently.</u>
  - 2. Use Chart 1503.3.3 to determine intermittent factor (Whole House Required CFM x Factor = Intermittent CFM):

RUN-TIME PERCENTAGE IN EACH 4-HOUR SEGMENT	25%	33%	50%	66%	75%	100%
Factor	4	3	2	1.5	1.3	1.0

*Exception Example:* 2000 sq. ft. Home with 2 Baths

- Whole House Requirement = 60 CFM continuous
- Exception: Use a timer to run fan 25% of the four hour period
- The intermittent CFM requirement would be 240 CFM to operate at 25%



#### The Code Specifies:

- 1. Whole-house Ventilation AND Local Exhaust is required
- 2. Bathroom & toilet air must be exhausted directly to the outdoors and shall not be recirculated within residence

#### **Local Exhaust Ventilation Requirements**

1. Exhaust the minimum air flow rate based on Table M1507.4

AREA TO BE EXHAUSTED	EXHAUST RATES
Kitchens	100 cfm intermittent or 25 cfm continuous
Rathroome Iollat Poome	Mechanical exhaust capacity of 50 cfm intermittent or 20 cfm continuous

#### **S&P's Recommended Solutions for Local Exhaust**

- GOOD: PC-Premium CHOICE Ventilation Fan (Ceiling Mounted Fan) BETTER: TD-MIXVENT (Mixed Flow Fan)
- **BEST:** TR or HR (ERV or HRV)

# IMC SECTIONS: THE CODE IN REGARDS TO VENTILATION

Section 2





#### **Sections Requiring Ventilation**

- Ventilation System (403.1)
- Outdoor Air Required (403.2)
- Min Air Flow Rates (403.3)
- Exhaust Ventilation (403.4)
- Variable Air Volume system control (403.6)
- Balancing (403.7)

#### 2012 Code Applies to Multi-Family Projects





#### 403.1 (Ventilation System) - The Code Specifies:

- 1. Supply and Return (Exhaust) Air is required
- 2. Supply Air must equal mount of Exhaust Air

#### **403.2 (Outdoor Air Required) – The Code Specifies**

- 1. Minimum airflow rate determined by Section 403.3
- 2. Must deliver required rate of outdoor airflow to the BREATING ZONE within each OCCUPIABLE SPACE

#### 403.4 (Exhaust Ventilation) – The Code Specifies

- 1. Exhaust airflow rate determined by Section 403.3
- 2. Exhaust makeup air can be combination of outdoor air, recirculated air and transfer (except as limited by Section 403.2)

#### All IRC 2012 Residential Solutions can be used as IMC 2012 Commercial Solutions!

#### Section 1502 M1502

#### Section 403.3 Minimum Air Flow Rates



	OCCUPANCY CLASSIFICATION	OCCUPANT DENSITY #/1000 FT2a	PEOPLE OUTDOOR AIRFLOW RATE IN BREATHING ZONE, R_CFM/PERSON	AREA OUTDOOR AIRFLOW RATE IN BREATHING ZONE, R, CFM/FT <sup>28</sup>	EXHAUST AIRFLOW RATE CFM/FT <sup>28</sup>	
		122 12 (0.55) (0.56)	ctional facilities	N, 01 MIT 1		1
	Cells			<u> </u>		
	without plumbing fixtures	25	5	0.12		
	with plumbing fixtures <sup>a</sup>	25	5	0.12	1	BREATHING
	Dining halls (see food and beverage service)	_	_	-	-	ZONES
	Guard stations	15	5	0.06		ZUNES
	Day room	30	5	0.06	8 <b>—</b> 8	
	Booking/waiting	50	7.5	0.06	-	
		Dry cle	aners, laundries			
	Coin-operated dry cleaner	20	15	2 <del></del> 2	8- <b></b> -5	
	Coin-operated laundries	20	7.5	0.06	<u></u>	
	Commercial dry cleaner	30	30		1 - S	
	Commercial laundry	10	25	5 <del></del>	8 <u>—</u> 8	
	Storage, pick up	30	7.5	0.12	<u> </u>	
			Education			
	Auditoriums	150	5	0.06		
	Corridors (see public spaces)		1	3	1.00	Exhaust
	Media center	25	10	0.12		
SPACE	Sports locker rooms <sup>a</sup>	<u>1997</u>	<u></u>	-	0.5	Airflow Rate
JFACE	Music/theater/dance	35	10	0.06	8 <del></del>	
	Smoking lounges <sup>₅</sup>	70	60			
	Day care (through age 4)	25	10	0.18		
	Classrooms (ages 5-8)	25	10	0.12	10-10 C	
	Classrooms (age 9 plus)	35	10	0.12	-	
	Lecture classroom	65	7.5	0.06	<u> </u>	
	Lecture hall (fixed seats)	150	7.5	0.06	-	
	Art classroom <sup>e</sup>	20	10	0.18	0.7	
	Science laboratories <sup>e</sup>	25	10	0.18	1	
	Wood/metal shops <sup>e</sup>	20	10	0.18	0.5	
	Computer lab	25	10	0.12	<u> </u>	
	Multiuse assembly	100	7.5	0.06	10-10 S	
	Locker/dressing rooms <sup>a</sup>	—	—	-	0.25	
		Food and	beverage service			
	Bars, cocktail lounges	100	7.5	0.18	. <del></del> .	
	Cafeteria, fast food	100	7.5	0.18	9 <del>-</del> 2	
	Dining rooms	70	7.5	0.18		
	Kitchens (cooking) <sup>b</sup>			( <del></del> )	0.7	

Section 1502 M1502

#### **The Code Specifies:**

- 1. Controls required to regulate the flow of outdoor air
- 2. Control system must be designed to maintain the outdoor airflow rate required by Section 403.3

#### **S&P Solutions for Controls**

- 1. CVC Continuous Ventilation Controls
  - 1. Designed exclusively for TD-100, TD-100x and TD-150 to allow the fans to run continuously at a low rate
- 2. Percentage Timers
  - 1. Multiple options based on fan chosen!

TR Specific













- Supply Air is just as important as Exhaust Air
- S&P offers a number of efficient and cost effective solutions to the IRC 2012 Chapter 15 Requirements
- All the products we discussed in the residential section translate into commercial.



#### S&P Exhaust & Supply Options

#### **TD-MIXVENT and TD-SILENT**



#### **PC-Premium CHOICE Fans**



#### TR & HR (ERVs & HRVs)







# Thank you!

# Any Questions?