

Measurements at high voltage

Carried out by: Shaimuradov E.

Group: Ea-15-10

Almaty University of Power Engineering


Measurement instruments

In high voltage installations, sufficient measurement accuracy is ensured by the use of special methods, the effectiveness of which has been verified by numerous experimental studies. The accuracy of measurements also depends on the technical qualifications of the staff. For high-voltage tests, the following measuring devices are most often used:

- peak-voltmeters;
- ball arresters;
- high-voltage electrostatic voltmeters
- electrostatic voltmeters and measuring devices of low voltage in conjunction with voltage dividers

Peak voltmeter

To measure pulsating, alternating and pulsed voltages, devices with various circuits for switching capacitors and rectifiers are used. The simplest example of such a device is a peak voltmeter (Fig. 11,12)

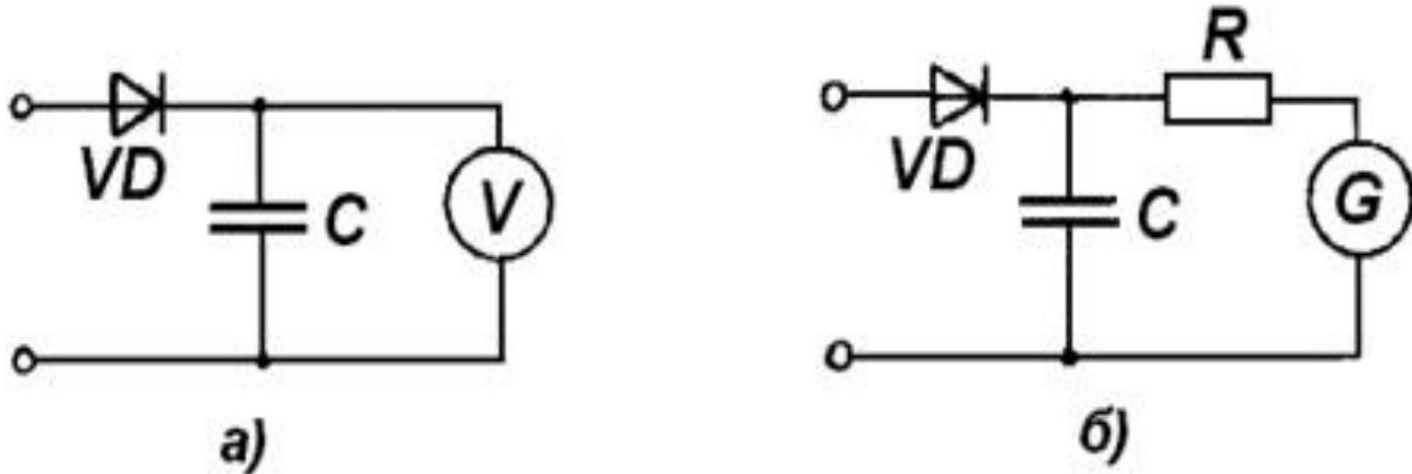

When a voltage pulse is applied to the peak voltmeter, the capacitor C is charged up to the amplitude value of the input voltage. The magnitude of this voltage is then measured using a voltmeter V with a large input resistance or a ballistic galvanometer G

To expand the range of measured voltages, peak-voltmeters with a voltage divider

Ball arresters

The essence of measuring high voltage with a ball discharger is that a discharge in a weakly inhomogeneous field between two spherical electrodes in the air arises at a certain voltage with a small spread and a small delay.

The discharge voltage for a given diameter of the balls and the method of their inclusion depends linearly on the distance between the balls. A high-voltage amplitude value is measured using a ball-gage.

The discharge voltage depends on pressure, temperature and humidity. In the standard tables, breakdown voltages U_{br} are given, corresponding to a normal pressure of 760 mm Hg. (100 kPa) and a normal temperature of 20 ° C. If the pressure p and the temperature t differ from the normal ones, the breakdown voltage U_{brb} is determined by the formula:

$$U_{breakdown} = U_{breakdown\ of\ balls} \times \sigma$$

$$\sigma = \frac{(273+t_0) \times p}{(273+t) \times p_c}$$

For distances d between balls to $0.5D$ (where D is the diameter of the ball), the table gives the value of the discharge voltage with an error not exceeding $\pm 3\%$, and for distances from $0.5D$ to $0.75D$ with a greater error. At distances greater than $0.75D$, measurements by balls are not recommended. Thus, the following inequalities must be satisfied in the measurements:

$$\frac{d}{D} \leq 0,75$$

To protect the surface of the balls from fusion and erosion, as well as to suppress high-frequency oscillations during breakdowns, an additional resistance of $0.1-0.0 \text{ M}\Omega$ should be connected in series with the ball discharger.

The wide application of ball gaps to measure high voltages is explained by the simplicity of their arrangement and the accuracy acceptable for practice. However, a measurement accuracy of $\pm 3\%$ is only possible with a strictly spherical surface of the electrodes. The diameter of the balls should not differ from the standard by more than $\pm 0.1\%$. Surfaces of balls should be polished, dry and clean.

When measuring impulse voltages, one should take into account the influence on the accuracy of measuring the pulse duration of the acting voltage, the steepness of its front and polarity.

Electrostatic voltmeters

Electrostatic voltmeters are used to measure the effective values of steady-state or periodically varying voltages. The principle of operation of electrostatic voltmeters is based on the use of the interaction force between two electrodes in the electric field of the measured voltage. The voltmeter S-96 (for voltages up to 30 kV) and S-100 (for voltages up to 75 kV) with an error of no more than 1.5% are widely used for measurement. Voltage dividers are used to expand the range of the measured voltages of electrostatic voltmeters and to measure the measured quantities using oscilloscopy. Voltage dividers make it possible to record, with the help of low-voltage measuring devices (voltmeters, oscilloscopes, etc.) practically unlimited in amplitude constant, alternating and impulse voltages. The part of the divider parallel to which the measuring device is switched on is considered to be the low-voltage divider arm. The rest is called the high-voltage divider arm. The ratio of the voltage at the input of the divider U_1 , to the voltage on the measuring instrument U_2 , is called the division coefficient of the divider.

To ensure the fixation of the process under investigation in high-voltage installations without distortion, voltage dividers must satisfy the following conditions:

- 1) when connected to the circuit under test, do not influence the amplitude and shape of the measured voltage;
- 2) have a pressure coefficient that does not depend on the frequency and amplitude of the measured voltage in the working range of variation of these quantities, and also on the change in external atmospheric conditions

3) on the divider elements there should not be a crown, and the leakage currents through the insulation must be much less than the operating current in the circuit of the divider itself.

- Voltage dividers are active, capacitive and combined. To measure a rectified or alternating voltage of an industrial frequency, active dividers made of wire or non-wire resistors can be successfully used. For wire resistors use nichrome, constantan, manganin. An obligatory condition for the manufacture of wire active voltage dividers is bifilar winding of the wire in order to reduce the inductance of the divider.
- To reduce the error in the division factor caused by leakage through the insulation and the crown, the resistance of the active divider is adopted so that the current flowing through it is within 1-10 mA. In those cases where greater measurement accuracy is not required, non-wire resistors of composite type are used to manufacture active voltage dividers. On an alternating current, the measurement error in the case of active dividers is sharply increased due to the influence of parasitic capacitances.
- To measure high voltages of the industrial frequency, capacitor dividers are used more often, which, compared to the active ones, have smaller dimensions and cost. An important advantage of capacitive dividers is the insignificant effect on their coefficient of division of parasitic capacitances and negligible consumption of active energy. In capacitive dividers, capacitors with ceramic dielectrics with negligible inductance and high electrical strength are most often used, for example, ceramic capacitors K15U

All types of dividers can be used to fix pulse voltages, however, when using active divisors, the measurement error due to the inductance of resistors and parasitic capacitances is usually higher. To reduce the effect of parasitic capacitance on the dividing ratio of the divider, screen electrodes are used, which help to reduce the capacitive currents in its circuit. Typically, for this purpose, an annular electrode is placed slightly below the high-voltage input of the divider and connected to it by several radial conductors. An active divider with such a screen makes it possible to record a cut off voltage wave of less than $1\text{ }\mu\text{s}$ with an error of 2-3%.

THANKS FOR ATTENTION